

CONTRACT AND SPECIFICATIONS

East Gate Plaza Water Meter House

CITY OF HASTINGS

Contract No. HU 2026-28

Sealed Proposals Will Be Opened Promptly At
4:00 PM, Wednesday, March 18, 2026

Bid Submitted By: _____



ADVERTISEMENT FOR BIDS

The City of Hastings, Nebraska, will receive bids for the: **Contract No. HU 2026-28: East Gate Plaza Water Meter House.** until 4:00 p.m. at the City of Hastings, 1228 N Denver Ave., Hastings, Nebraska, on Wednesday, March 18, 2026, at which time and place all bids will be publicly opened and read aloud.

Brief description of project: Install new 6” water service and distribution piping and building with internal plumbing. If you plan on bidding and are not already on our approved bidders list for this project, you are REQUIRED to fill out the Plan Holders Submittal Form that is located on the City website: <https://www.cityofhastings.org/bids/> .

The Contract Documents, including plans and specifications, are on file at the City of Hastings, 1228 N Denver Avenue, Hastings, Nebraska 68901. Copies of the plans and specifications in electronic (PDF) format may be obtained by visiting the City of Hastings Website: www.cityofhastings.org/bids. A paper copy is available for \$75.00, plus sales tax (\$5.25), plus shipping.

Each bid shall be accompanied by a certified check, drawn on a solvent bank in the State of Nebraska, or a bid bond in an amount of not less than five percent (5%) of the total bid of all contract construction costs, made payable to the City Treasurer of the City of Hastings, Nebraska, as security that the bidder to whom the contract may be awarded will enter into a contract to build all the improvements in accordance with this notice and give bond in the sum hereinafter provided for the construction of improvements.

No bid shall be withdrawn after opening of bids without the consent of the City of Hastings, Nebraska, for a period of sixty (60) days after scheduled time of closing bids.

Time is of the essence in this contract. In evaluating bid(s) received, the City will consider the timelines of completion of prior construction contracts, existing workload of bidders and available manpower that bidder commits to the project.

The successful bidder will be required to furnish a Maintenance Bond in the sum of the full amount of the Contract within ten (10) days of the date of award. No additional time will be allowed the Contractor for providing the Maintenance Bond.

DATED AT HASTINGS, NEBRASKA, this 23rd day of February 2026.

Tyler Ficken, City Clerk

Table of Contents

**CONTRACT AND SPECIFICATIONS
FOR
East Gate Plaza Water Meter House
FOR
CITY OF HASTINGS
HASTINGS, NEBRASKA**

Contract No. HU 2026-28

I. BIDDING DOCUMENTS

Advertisement for Bids1
Instruction to Bidders.....3
Contact Sheet...4
Submittal Instructions5
Mailing Instructions6

II. CONTRACT FORMS

Proposal.....7-9
AIS Acknowledgement.....10
Formal Contract Agreement11-12
Insurance13
Maintenance Bond14-15
Affidavit.....16

III. TECHNICAL SPECIFICATIONS

Section 1 - General Conditions1-27
Section 2 – Special Conditions1-7
Section 3 – General Description and Scope of Work1
Section 4 – Water Main Specifications.....1-18
Section 5 – Piping Specifications1-2
Section 6 – Building Performance Specification1-3
Appendix A – Attachments.....1-5

INSTRUCTIONS TO BIDDERS

All proposal information, including any unit price fill in sheets or other required information, shall be submitted on the proposal forms hereto attached. Copies of addenda, if any, shall be signed and attached. City of Hastings does NOT accept faxed or emailed bid returns.

Bidders shall inform themselves of all relevant matters, and, if awarded the contract, shall not be allowed any extra compensation by reason of any matter or thing concerning which such Bidder might not have fully informed themselves, prior to the bidding.

The Bidder bidding on the Specifications herein, who has exceptions to those called for in the Specifications, must so state in the space provided below and/or attach a letter explaining in detail the exceptions taken to those required in the Specifications. This letter of explanation shall become a part of the bid and shall be attached hereto. Failure by the Bidder to outline his exceptions will require the successful Bidder to comply with these Specifications.

EXCEPTIONS TO SPECIFICATIONS:

The Purchaser will not assume obligations resulting from losses or damages until acceptance of the equipment.

Checks of unsuccessful Bidders will be returned when their bids have been rejected and they will not be retained in excess of sixty (60) days from the date bids are opened. The check of the successful Bidder will be retained until the contract is awarded. Should the successful Bidder fail to perform as the Proposal and Specifications indicate, the City may use the check as liquidated damages within fifteen (15) days after written notice is given to the party who submitted the successful bid.

If any person contemplating submitting a bid for this contract is in doubt as to the true meaning of any part of the Specifications or other proposed contract documents, he may submit to Purchaser a written request for an interpretation thereof. The person submitting the request will be responsible for its prompt delivery. Any interpretation of the proposed documents will be made only by addendum duly issued or delivered to each person receiving a set of such documents. The Purchaser will not be responsible for any other explanation or interpretation of the proposed documents.

All addendums must be signed and attached to bid documents.

**IF YOU HAVE QUESTIONS OR NEED HELP ON
SPECIFICATIONS CONTRACT NO: HU 2026-28**

East Gate Plaza Water Meter House

PLEASE CONTACT ANY OF THE FOLLOWING:

Technical Questions

Keith Miller
Engineer
Ph# 402-462-3549
Email: bidquestions@cityofhastings.org

General Questions or Requests

Rena Griess
Engineering Admin Assistant
Ph# 402-462-3665
Email: bidquestions@cityofhastings.org



SUBMITTAL INSTRUCTIONS

Your bid must be returned by means of hand delivery, USPS, FedEx, UPS, or other carrier. City of Hastings DOES NOT ACCEPT bids that are faxed or emailed.

ALL the following documents are REQUIRED TO BE SUBMITTED in your bid packet:

- 1. Cover sheet with your company's name filled in**
- 2. ALL addendums received – must be acknowledged and signed**
- 3. Bid Bond**
- 4. If “exceptions” are taken, include Instructions to Bidders**
- 5. Proposal Page(s)**

Failure to return required bid documents as instructed could subject your bid proposal to be rejected.

IMPORTANT MAILING (OR HAND DELIVERY) INSTRUCTIONS


Please address your return envelope as shown in the example below. All bids must be sealed in a properly marked envelope.

To hand deliver, please drop off between the hours of 8:00am – 5:00pm Monday-Friday.

Your Return Address

City of Hastings
Attn: Renae Griess
1228 N Denver Avenue
Hastings, NE 68901

**This Information MUST BE typed or written in the lower left hand corner of return envelope
OR SIMPLY CUT OUT AND TAPE ON YOUR RETURN ENVELOPE**



BID DOCUMENTS ENCLOSED
ATTN: Renae Griess, Administrative Assistant
Contract No: HU 2026-28
East Gate Plaza Water Meter House
Bid Opens: Wednesday, March 18, 2026 @ 4:00 PM

If returning Fed-X or similar carrier, please enclose the bid in an “inner” envelope which is sealed. Please make sure BOTH envelopes are properly marked on the OUTSIDE OF THE ENVELOPE as shown in the example above.

One bid per envelope. Bid submittal via email is not allowed. Bids must be checked in to the City of Hastings prior to 4:00pm deadline.

**FORMAL PROPOSAL FOR
EAST GATE PLAZA WATER METER HOUSE
CITY OF HASTINGS
CONTRACT NO. HU 2026-28**

TO: City of Hastings
1228 N Denver Avenue
Hastings NE 68901

BID OPENS: March 18, 2026 @ 4:00 PM

**SEALED BIDS MUST BE RECEIVED NO LATER
THAN 1:30 PM SAME DAY. BIDS RECEIVED AFTER
THAT TIME WILL NOT BE ACCEPTED.**

We, the undersigned, being familiar with all parts of these documents, being Notice to Bidders, Bid Proposal Price Sheets, Contract Document Forms, Plans and Specifications, Affidavit, Material List, and all other parts of this document, do herein submit our proposal to furnish, install, and perform all tasks required to complete said project area(s) for the total costs; including all necessary state and local sales taxes, and any other required taxes.

Completion Date: June 30, 2026

**Any modifications of bid proposal will be considered non-conformance of the bid.
All exceptions to the proposal shall be noted as an exception of the bid.**

Project Line Items

Item	Quantity		Description	Unit Price		Total
1	1	EA	MOBILIZATION		EA	
2	1	LS	METER BUILDING		LS	
3	1	LS	ELECTRICAL IMPROVEMENTS		LS	
4	1	LS	REMOVE WATER METER PIT		LS	
5	1	EA	REMOVE EXISTING VALVE		EA	
6	32	SY	REMOVE EXISTING PAVEMENT		SY	
7	75	SY	REMOVE & REPLACE EXISTING PAVEMENT		EA	
8	276	LF	6" DIP PC350		LF	
9*	1	EA	10"x6" MJ TAPPING TEE & VALVE	\$4,746.82	EA	\$ 4,746.82
10	2	EA	6"x6" MJ TEE		EA	
11	4	EA	6"x6" FL TEE		EA	
12	4	EA	6" MJ PLUG		EA	
13	2	EA	6" MJ 90°		EA	
14	4	EA	6" FL 90°		EA	
15	4	EA	6" MJ 22.5°		EA	
16	4	EA	6" MJ Gate Valve		EA	
17	8	EA	6" FL NRS Gate Valve		EA	
18	2	EA	6"x4" MJ Tee		EA	
19	32	LF	6" DIP SPOOLS		LF	
20	14	EA	6" MEGALUG		EA	
21	2	EA	4" MEGALUG		EA	
22	2	EA	4" COUPLING		EA	
23	4	LF	4" DIP PC350		LF	
24	1	LS	TRACER WIRE, RISER, BURY TAPE		LS	
25	6	EA	PIPE SUPPORT		EA	
26	2	EA	6" DISMANTLING JOINT		EA	

**FORMAL PROPOSAL FOR
EAST GATE PLAZA WATER METER HOUSE
CITY OF HASTINGS
CONTRACT NO. HU 2026-28**

27	2	EA	RPZ ASSEMBLY		EA	
28*	1	LS	6" COMPOUND WATER METER	\$9,188.26	LS	\$ 9,188.26
29	30	LF	4" SDR 35 DRAIN PIPE		LF	
30	3	EA	4" SDR 35 45° BEND		EA	
31	1	EA	4" SDR 35 WYE		EA	
32	2	EA	4" SDR 35 TRAP		EA	
33	2	EA	12" Ø x 6" SUMP W/ 4" FLOOR DRAIN		EA	
Total Cost Base Bid:						\$
(In Words)						
By:			Date:			
Signature:						

*City of Hastings supplied and paid for by contractor.

For purposes of sales/use tax, this project falls under Nebraska Sales and Use Tax Regulation 1-017 for Contractors. By definition, a contractor is "any person who repairs property annexed to, or who annexes property to, real estate, including leased property, by attaching building materials to the annexed property or improvement being built or repaired, or who arranges for annexation of property." Please refer to www.revenue.nebraska.gov/salestax.html for additional information.

For calculating this proposal:

- All contractors are to include sales/use tax on materials in the bidder's prices if applicable.
- **Option 1 contractors must separately state materials, sales tax, labor, and other charges on all invoices for the project. Any invoices submitted that do not include this required breakdown of the charges will not be accepted for payment. (This requirement does not apply to Option 2 or 3 contractors.)**
- The sales/use tax rate on building materials is 7.0% for projects within Hastings' city limits and 5.5% for projects outside of city limits.
- Contractor labor charges for this proposal are not subject to sales/use tax per the Nebraska Department of Revenue Notice to Contractors effective October 1, 2007.
- In submitting this bid, the bidder certifies that he will comply with all applicable laws, ordinances, and codes of the City of Hastings and the State of Nebraska.
- **Project is located INSIDE OF CITY LIMITS (7%)**

What contractor option have you registered with the Nebraska Department of Labor (must select one)? Please refer to <https://dol.nebraska.gov> for additional information.

- Option 1 _____
- Option 2 _____
- Option 3 _____

**FORMAL PROPOSAL FOR
EAST GATE PLAZA WATER METER HOUSE
CITY OF HASTINGS
CONTRACT NO. HU 2026-28**

Any modification of bid proposal will be considered non-conformance of the bid. All exceptions to the proposal shall be noted as an exception to the bid.

Exceptions: No Yes (If yes, list on ***“Instructions to Bidders”*** page)

Liquidated Damage: The Contractor shall pay a fee of \$100.00 per working day for failure to perform work within either the specified project period or the contract completion date in accordance with Paragraph 1.806 and 1.807 of the general conditions and Paragraph 2.002 of the Special Provision.

City of Hastings may at its own discretion delete any project area prior to award of contract.

In submitting this proposal, it is further understood that the City of Hastings Utilities Department reserves the right to reject any or all proposals, whether the price is the lowest or not, and may waive any informalities and may accept the proposal which best suits its needs. It is further understood that this proposal may not be withdrawn for a period of sixty days (60) days after the bids are opened.

All bid documents, including proposals, bid bonds, etc., must be submitted with original signatures. No copies will be accepted.

OFFICIAL NAME & ADDRESS

Firm Name

Address

City, State, Zip

Phone No.

Fax No.

Signature

Typed or Printed Name

Title

Date

Email Address

AMERICAN IRON AND STEEL (AIS) AGREEMENT

Contract: HU 2026-28

The Contractor acknowledges to and for the benefit of the City of Hastings (“Purchaser”) and the Nebraska Department of Transportation (the “State”) that it understands the goods and services under this Agreement are being funded with monies made available by the Nebraska Department of Transportation that have statutory requirements commonly known as “American Iron and Steel;” that requires all of the iron and steel products used in the project to be produced in the United States (“American Iron and Steel Requirement”) including iron and steel products provided by the Contactor pursuant to this Agreement. The Contractor hereby represents and warrants to and for the benefit of the Purchaser and the State that (a) the Contractor has reviewed and understands the American Iron and Steel Requirement, (b) all of the iron and steel products used in the project will be and/or have been produced in the United States in a manner that complies with the American Iron and Steel Requirement, unless a waiver of the requirement is approved, and (c) the Contractor will provide any further verified information, certification or assurance of compliance with this paragraph, or information necessary to support a waiver of the American Iron and Steel Requirement, as may be requested by the Purchaser or the State. Notwithstanding any other provision of this Agreement, any failure to comply with this paragraph by the Contractor shall permit the Purchaser or State to recover as damages against the Contractor any loss, expense, or cost (including without limitation attorney’s fees) incurred by the Purchaser or State resulting from any such failure (including without limitation any impairment or loss of funding, whether in whole or in part, from the State or any damages owed to the State by the Purchaser). While the Contractor has no direct contractual privity with the State, as a lender to the Purchaser for the funding of its project, the Purchaser and the Contractor agree that the State is a third party beneficiary and neither this paragraph (nor any other provision of this Agreement necessary to give this paragraph force or effect) shall be amended or waived without the prior written consent of the State.

Contractor Signature

This form must be returned with bid submission.

AGREEMENT

THIS AGREEMENT, made and entered into this day of , 2026,
by and between the City of Hastings, Party of the First Part, hereinafter called the "Purchaser" or
"City", and , a of (town) in the State
of , Party of the Second Part, hereinafter called the "Contractor".

WITNESSETH: THAT,

WHEREAS: The Purchaser has caused the necessary contract documents to be prepared for defining material, equipment, and/or labor to be supplied to the City of Hastings, and delivered complete as specified in the accompanying contract documents.

WHEREAS: The Purchaser has advertised for bids from Contractors, has received said bids, analyzed same and duly awarded a contract to the "Contractor", "Party of the Second Part", for material, equipment, and/or labor as hereinafter set forth and as stated more in detail in the Proposal and related contract documents to wit; Notice to Bidders, Instructions to Bidders, Specifications; all of which documents are attached hereto and made a part of this Contract.

NOW, THEREFORE: It is hereby agreed that for the sum of . (\$)

to be paid by the Purchaser, within Thirty (30) days after the acceptance of material, equipment, and/or labor by the Purchaser, to the Contractor, the Contractor agrees to furnish all materials, equipment, and/or labor as required by the accompanying specifications, and the aforesaid contract documents, for **Contract No. HU 2026-28: East Gate Plaza Water Meter House.**

All materials, equipment, and/or labor shall be in accordance with the accompanying contract documents and specifications which are as much a part of this Agreement as if repeated verbatim herein.

It is further agreed that the Contractor will start work promptly, furnish the necessary drawings promptly and complete the work in the number of days set forth in the Proposal.

AGREEMENT

IN WITNESS WHEREOF: The Parties of the First and Second Parts have hereto set their hands and seals on the day and year above written.

CITY OF HASTINGS
Party of the First Part

By: _____

Date: _____

ATTEST:

City Clerk

CONTRACTOR
Party of the Second Part

SEAL

By: _____

Title: _____

Date: _____

APPROVED TO FORM:

City Attorney

Note: If executed by one other than President, Partner or the individual Owner, a Power-of-Attorney authorizing execution should accompany this Contract.

INSURANCE COVERAGE

The undersigned hereby certifies that Workmen's Compensation, Public Liability and Property Damage, and Automobile Liability and Property Damage Insurance are in force and effect in accordance with the requirements contained in "Instruction to Bidders" which is a part of this document "Bid Proposal and Specifications". We further agree to give ten (10) days notice to the City of Hastings before effective date of cancellation or reduction of any of the above coverage.

This Insurance Coverage applies only to _____

Dated _____

CONTRACTOR

By _____

Title _____

Date _____

INSURANCE COMPANY

By _____

Title _____

Address _____

Date _____

MAINTENANCE BOND

KNOW ALL MEN BY THESE PRESENTS That we, _____
_____, hereinafter
called the Principal, and _____

hereinafter called the Surety, are held and firmly bound unto the CITY OF HASTINGS, County
of ADAMS, State of NEBRASKA, hereinafter called the Owner in the sum of _____
_____ Dollars: \$ _____

lawful money of the United States of America, to be paid to the CITY OF HASTINGS,
NEBRASKA, for the payment whereof the Principal and Surety hold themselves, their heirs,
executors, administrators, successors and assigns, jointly and severally, firmly by these presents.

WHEREAS, the Principal has, by means of a written agreement dated _____
20 _____, entered into a contract with the CITY OF HASTINGS, NEBRASKA, for the

a copy of which contract is by reference made a part hereof.

NOW, THEREFORE, the conditions of this obligation are such that

FIRST: If the Principal shall faithfully perform the contract on his part, and satisfy all claims
and demands incurred for the same and shall fully indemnify and save harmless the CITY OF
HASTINGS, NEBRASKA, from all cost and damage which said Owner may suffer by reason of
failure so to do, and shall fully reimburse and repay said Owner all outlay and expense which
said Owner may incur in making good any such default, and shall pay all persons who have
contracts directly with the Principal for labor and materials, and

SECOND: The Principal shall protect and hold harmless the CITY OF HASTINGS,
NEBRASKA, from any and all suits and actions of every description that may be brought
against said Owner on account of injuries to or death of persons or damage to property received
or sustained by any person or persons through the negligence of the Principal or his agents; and

THIRD: The Principal shall warrant the work constructed under his contract and keep in good repair at no cost to Eastgate Plaza, 1100 E South St, Hastings, NE 68901 for a period of ONE (1) year(s) from date of formal acceptance by said Owner, then this obligation shall be null and void, otherwise it shall remain in full force and effect.

The Principal and Surety or Sureties on this bond hereby agree to pay all persons, firms, or corporations having contracts directly with the Principal or with subcontractors, all just claims due them for labor performed or material furnished in the performance of the contract on account of which this bond is given, when the same are not satisfied out of the portion of the contract price which the public corporation is required to retain until the completion of the public improvement, but the Principal and Surety shall not be liable to said persons, firms, or corporations unless the claims of said claimants against said portion of the contract price shall have been established by law.

Every surety on this bond shall be deemed and held, any contract to the contrary notwithstanding, to consent without notice:

1. To any extension of time to the Contractor in which to perform the contract.
2. To any change in the plans, specifications or contract, when such change does not involve an increase or more than twenty percent (20%) of the total contract price, and shall then be released only as to such excess increase.
3. That no provision of this bond or of any other contract shall be valid which limits to less than five years from time of acceptance of the work the right to sue on this bond for defects in workmanship or material not discovered or known to the obligee at the time such work was accepted.

SIGNED AND SEALED THIS _____ day of _____ 20____

IN PRESENCE OF:

(Principal)

By _____
(Name) (Title)

Countersigned:

(Surety)

Resident Agent

By _____
(Attorney-in-fact)

Filed in my office this _____ day of _____ 20____

(Clerk)

SECTION 1

GENERAL CONDITIONS

SECTION 1-1 - DEFINITION OF WORDS AND TERMS

Wherever in these specifications or in other contract documents the following terms or pronouns in place of them are used, the intent and meaning shall be interpreted as follows:

1.101 Advertisement. The advertisement for work or materials on which bids are to be received.

1.102 Award. The decision of the City to accept the proposal of the lowest responsible bidder for the work, subject to the execution and approval of a satisfactory contract thereof and bond to secure the performance thereof, and to such other conditions as may be specified or otherwise required by law.

1.103 Bidder. Any individual, firm, or corporation formally submitting a proposal for the work contemplated, acting directly or through a duly authorized representative.

1.104 Calendar Day. Every day shown on the calendar, except weekends and holidays included: New Year's Day, Martin Luther King Day, Memorial Day, Independence Day, Labor Day, Veteran's Day, Thanksgiving, Friday after Thanksgiving, ½ Day Christmas Eve, and Christmas Day.

1.105 Change Order. A written order to the Contractor, signed by the Engineer, ordering a change in the work from that originally shown in the plans and specifications.

1.106 City. The word "City" as used in these specifications refers to City of Hastings, Nebraska.

1.107 Contract. The written agreement executed between the City and the Contractor, covering the performance of the work and the furnishing of labor and materials, by which the Contractor is bound to perform the work and furnish the labor and materials, and by which the City is obligated to compensate him therefore at the mutually established and accepted rate or price.

The contract shall include the "Notice to Bidders", these specifications, the Contractor's Bond, the general and detailed plans, the Proposal, Special Provisions, and Supplemental Agreements.

1.108 Contract Item. An item of work specifically described and for which a price, either unit or lump sum, is provided. It includes the performance of all work and the furnishing of all labor, equipment, and materials described in the text of a specification item included in the contract or described in any subdivision of the text of the supplemental specification or special provision of the contract.

1.109 Contract Period. The period from the date specified in the contract for the commencement of work to the date specified for its completion, both dates inclusive.

SECTION 1- GENERAL CONDITIONS

1.110 Contractor. The party of the second part to the contract; the individual, firm, or corporation undertaking the execution of the work under the terms of the contract and acting directly or through his, their, or its agents or authorized employees.

1.111 Easement (Right-of-Way). A right acquired by public authority to use or control property for a designated purpose.

1.112 Engineer. The Director of Engineering, acting either directly or through an assistant or other representative duly authorized by the Director of Engineering, such assistant or representative acting within the scope of the particular duties assigned him, or of the authority given him.

1.113 Extra Work. Work performed by the Contractor in order to complete the contract in an acceptable manner but for which there is no basis of payment provided in the contract.

1.114 Inspector. An authorized representative of the Engineer assigned to make detailed inspection of any or all portions of the work performed and materials furnished by the Contractor.

1.115 Laboratory. The testing laboratory of the City or any other testing laboratory which may be designated by the Engineer.

1.116 Maintenance Bond. Insures the owner of a completed construction project for a specified time period against defects and faults in materials, workmanship and design.

1.117 Notice to Bidders. The provisions, requirements, and instructions pertaining to the work to be awarded, manner and time of submitting proposals, quantities of the major items or work required, as prepared for the information of bidders.

1.118 Performance Bond. The approved form of security, executed by the Contractor and his surety or sureties, guaranteeing complete execution of the contract and all supplemental agreements pertaining thereto and the payment of all legal debts pertaining to the construction of the project.

1.119 Plans. The official plans, profiles, working drawings, and supplemental drawings, or exact reproductions thereof, approved by the Engineer, which show the location, character, dimensions and details of the work to be done, and which are to be considered as a part of the contract supplementary to these specifications.

1.120 Project. The specific section of the street together with all appurtenances and construction to be performed thereon under the contract.

1.121 Proposal. The offer of the bidder, submitted on the prescribed proposal form, to perform the work and to furnish the labor and materials at the prices quoted by the bidder.

1.122 Proposal Form. The approved form on which the City requires formal bids be prepared and submitted.

SECTION 1- GENERAL CONDITIONS

1.123 Proposal Guaranty. The security furnished by the bidder with his proposal for a project, as a guaranty that he will enter into a contract for the work if his proposal is accepted.

1.124 Right-of-Way. The land area which is reserved or secured by the City for constructing the work or for obtaining material therefore.

1.125 Special Provisions. Special directions, provisions or requirements peculiar to the project under consideration and not otherwise thoroughly or satisfactorily detailed or set forth in the specifications. See Section II Special Provisions.

1.126 Specifications. The general term comprising all the directions, provisions, and requirements contained herein, together with such as may be added or adopted as supplemental specifications or special provisions, all of which are necessary for the proper performance of the contract.

1.127 Subcontractor. Any individual, firm, or corporation to whom the Contractor, with the written consent of the City, sublets any part of the contract.

1.128 Superintendent. The representative of the Contractor, present on the work at all times during progress, authorized to receive and fulfill instructions from the Engineer and capable of superintending the work efficiently.

1.129 Surety. The corporate body bound with and for the Contractor for the acceptable performance of the contract and the completion of the work, and for payment of all just claims arising therefrom.

1.130 Work. Work shall be understood to mean the furnishing of all labor, materials, equipment, paying all applicable city, state, and federal taxes, and other incidentals necessary or convenient to the successful completion of the project by the Contractor and the carrying out of all the duties and obligations imposed by the contract if applicable.

1.131 Working Day. Any day, except Saturdays, Sundays, and City of Hastings holidays. Working days for a project area shall be counted consecutively from project starting date.

1.132 Completion of the Work and Formal Acceptance by the City. Whenever the term "completion of the work and formal acceptance by the City" is used, it refers to and means the formal acceptance of the work by the Engineer and the City at the time the Contractor has all work under the contract completed and in place. Release of the final pay estimate shall constitute formal acceptance by the City.

1.133 Final Acceptance of the Work. Whenever the term "final acceptance of the work" is used, it refers to and means the time when the Engineer and City finally accept the work after the expiration of the time for which the Contractor guarantees to keep the work in repair.

1.134 Abbreviations.

A.A.S.H.O. American Association of State Highway Officials

SECTION 1- GENERAL CONDITIONS

A.S.M.E.	American Society of Mechanical Engineers
A.S.T.M.	American Society for Testing Materials
A.R.E.A.	American Railway Engineering Association
A.W.S.	American Welding Society
D.O.T.	Department of Transportation, Office of Pipeline Safety
O.S.H.A.	Occupational Safety and Health Administration
A.W.W.A.	American Water Works Association

SECTION 1-2 - PROPOSAL REQUIREMENTS AND CONDITIONS

1.201 Contents of Proposal Forms. Bidders will be furnished with proposal forms which will state the location and description of the contemplated work and will show the estimate of the various quantities and kinds of work to be performed or materials to be furnished, with a schedule of items for which unit bid prices are asked, and the time in which the work must be completed, and the date, time, and place of opening bids. All special provisions and required provisions will be grouped together and bound with or included through reference in the proposal form.

1.202 Interpretation of Quantities in Proposal Forms. The quantities listed in the proposal forms are to be considered as approximate, unless otherwise provided by special provision. It is understood that the quantities of work to be done and materials to be furnished may each be increased, diminished or omitted, as hereinafter provided, without in any way invalidating the unit bid prices, except as provided in Article 1.403.

1.203 Examination of Plans, Specifications, Special Provisions, and Site of Work. The bidder is required to examine carefully the site, and the proposal, plans, specifications, special provisions, and contract form, for the work contemplated, and it will be assumed that the bidder has investigated and is satisfied as to the conditions to be encountered, as to the character, quality, and quantities of work to be performed and materials to be furnished, and as to the requirements of these specifications, the special provisions, and contract. It is mutually agreed that the submission of a proposal shall be considered prima facie evidence that the bidder has made such examination.

1.204 Preparation of Proposal. Bidders shall submit their proposals on blank forms furnished by the Engineer, with the full name and address and the place of business or residence of the bidder. If the bidder is co-partnership, then the signature shall be by a member of the firm, with the names and addresses of each member; and if a corporation, then by an officer of the corporation in the corporate name and with the corporate name and with the corporate seal attached thereto.

All blank spaces in the form shall be fully filled; numbers shall be stated in legible figures and writing when required; the signature shall be longhand; and the complete form shall be without interlineation, alteration or erasure.

No oral, telegraphic, telephonic, faxes, or electronically mailed proposals or modifications will be considered.

SECTION 1- GENERAL CONDITIONS

When certain alternative prices, for both increasing and decreasing the cost, are required, as called for in the proposal sheet, it must be understood that all materials and workmanship required shall be the best of their respective kinds; and in all cases, shall correspond with similar work herein specified and, if accepted, the work shall be done under the general terms of the specifications.

1.205 Statement of Bidder's Financial Conditions. Any bidder may be required by the City to submit data to satisfy the City that such bidder is prepared to fulfill the contract if it is awarded to him.

1.206 Certified Check, Cashier's Check or Bid Bond. Each bidder must submit with his proposal a certified check, cashier's check or bid bond in the amount of not less than five percent (5%) of the amount bid, drawn to the order to the City of Hastings, Nebraska, guaranteeing the execution of the contract and bond required, within ten (10) days of the notification of award. Any certified check must be issued by a U.S. Commercial Bank.

1.207 Filing of Proposal. The proposal and the supporting proposal guaranty for each project shall be filed in separate but attached envelopes, so marked as to indicate their contents. All proposals shall be filed with the City at the place designated in the notice to bidders, prior to the time advertised for the opening of bids.

1.208 Withdrawal of Proposal. A bidder will be permitted to withdraw his proposal unopened after it has been submitted, if his request for withdrawal is made in writing and delivered personally by the bidder or his authorized representative prior to the time specified for opening bids.

1.209 Public Opening of Proposals. Proposals will be publicly opened and read at the time and place stipulated in the notice to bidders.

1.210 Material Guaranty. The bidder may be required to furnish a complete statement of the origin, composition, and manufacture of any or all materials to be used in the construction of the work, together with samples, which samples may be subjected to the tests provided for in these specifications to determine their quality and fitness for the work.

SECTION 1-3 - AWARD OF CONTRACT

1.301 Consideration of Proposals. After the proposals are opened and read, they will be compared on the basis of the summation of the products of the quantities shown in the bid schedule by the unit bid prices. The results of such comparisons will be immediately available to the public.

The right is reserved to reject any and all proposals and to waive technical errors as may be deemed best for the interest of the City.

1.302 Award of Contract. In the award of contract, consideration will be given not only to the prices bid but also the mechanical and other equipment available to the bidder, the financial

SECTION 1- GENERAL CONDITIONS

responsibility of the bidder, and his ability and experience in the performance of like or similar contracts.

The award of alternatives proposed will be selected not only of the price but of the quality of the products provided, availability of replacement parts, repair, connection to future or existing systems, longevity, durability, function, and all other engineering and operational consideration.

Award of contracts will be made as promptly as practical after bids have been opened and read. The City reserves the right to delay the award for such time as is needed for the consideration of the bids, and for the receipt of concurrence in recommended contract awards from other governmental agencies whose concurrence may be required.

1.303 Cancellation of Award. The City reserves the right to cancel the award of any contract at any time before the execution of the said contract by all parties without any liability against the City.

1.304 Return of Proposal Guaranty. Proposal guaranties will be returned to the unsuccessful bidders by mail promptly after the signing of the contract has been made. Return to the successful bidder will be made after the signing of the contract and filing of the contract bond.

1.305 Maintenance Bond. The Contractor shall furnish a maintenance bond with a company having the approval of the City in an amount of one hundred percent (100%) of the completed construction project for a specified time period of three (3) years against defects and faults in materials, workmanship, and design.

In the event that Contractor chooses to submit a bond other than the bond from contained in this package, such submission is done at the risk of the bidder. All such substituted bond forms shall contain indemnification both for performance and warranty as set out more fully in these documents

1.306 Performance Bond. The Contractor shall furnish a performance bond with a company having the approval of the City in an amount of one hundred percent (100%) of the contract price guaranteeing complete and faithful performance of the contract, payment of all bills of whatever nature which could become a lien against the property.

In the event that Contractor chooses to submit a bond other than the bond from contained in this package, such submission is done at the risk of the bidder. All such substituted bond forms shall contain indemnification both for performance and warranty as set out more fully in these documents.

1.307 Failure to Execute Contract. Failure to execute a contract and file an acceptable performance bond, as provided herein, within ten (10) days from date of award shall be just cause for the annulment of the award and the forfeiture of the certified check, bid bond, or cashier's check to the City, not as a penalty but in liquidation of damages sustained.

SECTION 1-4 - SCOPE OF WORK

1.401 Intent of Plans and Specifications. The intent of the plans and specifications is to provide for the construction and completion of every detail of the work described therein. It shall be understood by the Contractor that he will furnish all labor, materials if applicable, tools,

SECTION 1- GENERAL CONDITIONS

transportation, and supplies required for all or any part of the work to make each item complete in accordance with the spirit of the contract. It is understood that the apparent silence of the specifications as to any detail, or the apparent omission of a detailed description concerning any point, shall be regarded as meaning that only the best general practice is to prevail, and that only materials and workmanship of the best quality are to be used.

For the purpose of design and the preparation of the Engineer's estimate, the City may perform a reasonable amount of exploratory work to gain information relative to surface and subsurface conditions relating to types of soil, moisture content and types and extent of rock strata.

This information, when shown on the plan, represents to the best of the City's knowledge, conditions as of the date the survey was made. The appearance of this information on the plan will not constitute a guarantee that conditions other than those indicated will not be encountered at the time of construction.

The bidder may utilize this information as he sees fit. Any bidder interested in the work is authorized to make whatever additional investigation he considers advisable.

In making such additional investigation, the bidder is directed to the Engineer for information relating to available right-of-way. If there are, at that time, any parcels of land over which the City does not have jurisdiction, right of entry must be secured by the prospective bidder from those authorized to grant such permission.

1.402 Special Work. Any conditions not covered by these standard specifications are stated in the special provisions.

1.403 Increased or Decreased Quantities of Work. The Engineer reserves the right to alter the quantities of contract items for which there are bid prices. Such increases or decreases in quantities shall be made as he considers necessary or desirable without waiving or invalidating any of the provisions of the contract; provided, that all such alterations shall be ordered in writing and that a supplemental agreement shall be executed with the Contractor for the item or items involved, when such alterations involve an increase or decrease of more than twenty percent (20%) of the total cost of the work of any group of the contract calculated from the original proposal quantities and the contract unit prices. The Contractor shall not start on any alteration requiring a supplemental agreement until the agreement setting forth an equitable adjustment of compensation, satisfactory to both parties, shall have been executed by the Engineer and the Contractor.

1.404 Changes in Work - Change Order. The City reserves the right to order the performance of work of a class not contemplated in the proposal but which may be considered necessary to complete satisfactorily the work included in the contract. All change orders must be approved in writing prior to start of work.

- a. If applicable unit prices are not contained in the Agreement or if the total net change increases or decreases the total Contract Price more than twenty (20) percent, the City shall, before ordering the Contractor to proceed with desired changes, request an itemized proposal from him covering the work involved in the change after which the procedures shall be as follows:

SECTION 1- GENERAL CONDITIONS

1. If the proposal is acceptable, the City will prepare the change order in accordance therewith for acceptance by the Contractor.
 2. If the proposal is not acceptable and prompt agreement between the two parties cannot be reached, the City may order the Contractor to proceed with the work on a cost-plus-limited basis. A cost-plus-limited basis is defined as the net cost of the Contractor's labor, materials, and insurance plus fifteen (15) percent of said net cost to cover overhead and profit, the total cost not to exceed a specified limit.
- b. Each change order shall include in its final form:
1. A detailed description of the change in the work.
 2. The Contractor's proposal (if any) or a conformed copy thereof.
 3. A definite statement as to the resulting change in the Contract Price and any impacts on project schedule.
 4. The statement that all work involved in the change shall be performed in accordance with Contract requirements except as modified by the change order.

1.405 Removal and Disposal of Structures and Obstructions. The Contractor for bridge and culvert work shall remove any existing structure or part of structure that in any way interferes with the new construction. If specific payment for such work has not been provided in the contract, it will be paid for as extra work.

The Contractor shall remove any materials or structures found on the right-of-way which are not to remain in place or which have not been designated for use in the new construction. The removal and disposal of pipe culverts will not be paid for directly, but shall be considered as incidental work, and the cost of such removal and disposal shall be considered to be included in the contract price for other items. Pipe culverts shall be removed by methods that will cause a minimum of damage to the pipe culverts. The removal and disposal of bridges or other masonry or monolithic concrete construction will be paid for. If the contract does not contain an item for such work, it will be paid for as extra work. Whenever City of Hastings requires abandonment of old utility mains or services, the Contractor shall plug or cap all open ends.

1.406 Rights In and Use of Materials Found on the Right-of-Way. Unless stated to the contrary in the contract documents, all materials, such as stone, gravel, sand, timber, and structures or parts of structures, found on the right-of-way of the street or on land acquired for the work, are the property of the City or the City of the fee title to the land, and shall not be used or destroyed by the Contractor without special permission from the Engineer. When the Contractor is permitted to use materials found on the right-of-way, any excavations that he makes below the grade elevation shall be backfilled with other suitable materials so that the finished street will conform to the grade shown on the plans. No extra compensation will be allowed for such backfilling.

SECTION 1- GENERAL CONDITIONS

When rock excavation is encountered, any portion of rock excavation which would otherwise be deposited in waste areas and not be incorporated in the embankments may be processed and used, royalty free, by the Contractor in any other portion of the construction in which material of that quality would be acceptable. No deduction will be made from excavation quantities for rock so used.

1.407 Right-of-Way. Right-of-Way for the work will be provided without cost to the Contractor. Right-of-way will be made available to the Contractor on or before the date specified for the commencement of the work, unless a later date for the right-of-way to be made available to the Contractor is designated in the contract documents.

1.408 Railroad Crossings. Whenever the work involves construction with which railroad companies are concerned, the performance of the work is contingent upon arrangements with the railroad companies for the proposed construction. No claims will be allowed for loss or damage caused by failure to complete such arrangements. The Contractor is responsible to pay for any railroad required Contractor's fees.

SECTION 1-5 - CONTROL OF WORK

1.501 Authority of Engineer. The Engineer will decide any questions that arise with reference to the intent of the contract documents and compliance therewith. They will resolve all questions relating to materials, work, progress, disputes and mutual rights between contractors, fulfillment of contract and compensation, in accordance with the provisions of these specifications.

1.502 Plans and Working Drawings. The approved plans will be supplemented by such working drawings as are necessary to adequately control the work. It is mutually agreed that all authorized alterations affecting the requirements and information given in the approved plans shall be in writing.

Working drawings for any structure shall consist of such detailed plans as may be required of the Contractor for the execution of the work. These are not included in the plans furnished by the Engineer. They shall include shop details, erection plans, masonry, and form work. The Engineer's prior approval of the shop details must be obtained before any fabrication work involving these plans is performed. Erection plans, masonry layout diagrams, and plans for cribs, cofferdams, false work, centering and framework, as well as any other working drawings not previously mentioned, may be required of the Contractor and shall be subject to the Engineer's approval.

1.503 Alteration of Plans or of Character of Work. The Engineer shall have the right to make alterations in plans or character of work as may be considered necessary or desirable during the progress of the work to complete satisfactorily the proposed construction. Such alterations shall not be considered as a waiver of any conditions of the contract or invalidate any of the provisions thereof.

1.504 Coordination of Plans, Specifications, Special Provisions and Supplemental Specifications. These specifications, the supplemental specifications, the plans, special provisions, and all supplementary documents are essential parts of the contract, and a requirement occurring in one is as binding as though occurring in all. They are intended to be complimentary and to describe and provide for a complete work.

SECTION 1- GENERAL CONDITIONS

1.505 Cooperation of Contractor. The Contractor will be supply a minimum of two sets of approved plans and contract assemblies, including special provisions, one set of which the contractor shall keep available on the work at all times.

The Contractor shall give the work the constant attention necessary to facilitate the progress thereof, and shall cooperate with the Engineer and other contractors in every way possible.

Before any work is started, the contractor shall submit a project schedule for review. This schedule is to be updated monthly as progress may alter. Regular progress meetings may be scheduled at the discretion of the Engineer.

The Contractor shall at all times have on the work, as his agent, a competent superintendent capable of reading and thoroughly understanding the plans and specifications, knowledgeable in the pertinent industry codes and standards, thoroughly experienced in the type of work being performed, who shall receive instructions from the Engineer or his authorized representatives. In the event the superintendent fails to meet the requirements, they shall be subject to replacement as requested by the Engineer.

The superintendent shall have full authority to execute the orders or directions of the Engineer without delay, and to promptly supply such materials, equipment, tools, labor and incidentals as may be required. Such superintendent shall be furnished irrespective of the amount of work sublet.

Before starting any work under this Contract, the Contractor shall file with the City a letter signed by an officer of the company (or City, or partner, as the case may be), giving the name, address, and telephone number of the superintendent who is to represent the Contractor in all matters with prosecution of the work and who is to officially receive on behalf of the Contractor, notices or directions issued by the City or its Engineer, and act upon them as required. If, during the life of the Contract, a change in superintendents is made by the Contractor, a new letter shall be filed simultaneously with the change.

1.506 Surveys. Lines and elevations shall be established by the Engineer before the work commences, and the Contractor shall obtain lines and elevation from the points so set by the Engineer. The Contractor shall furnish all stakes necessary for lines and elevations and necessary cooperation for the Engineer in setting same.

All property pins, section corners, right of way monuments, permanent bench marks (brass caps), and all other survey monuments disturbed or removed by the Contractor shall be replaced by a licensed Surveyor at the expense of the Contractor. The Contractor shall take all necessary precaution to maintain in good condition all survey monuments.

The Contractor will insure the Engineer or his representative is present to verify the elevation of each sanitary sewer manhole set or tied into. The Contractor will also insure the Engineer or his representative is present to verify the location of all utilities (highways, railroads, drainage, etc.) uncovered, crossed, or otherwise exposed during the completion of the project. The Contractor shall keep the Engineer or his representative abreast of activities so adequate response by the Engineer or his representative can be made without unduly delaying the construction process. A

24 hour notice may be enforced if sufficient time is not allowed by the Engineer or his representative to conduct all necessary field surveys.

See specification 2.015 for additional information.

1.507 Authority and Duties of Inspector. The City may appoint inspectors to represent the Engineer in the inspection of all materials used in and all work done under the contract. Such inspection may extend to any part of the work and to the preparation of manufacture of the materials to be used. The Inspector will not be permitted to modify in any way the provisions of the contract documents, nor to delay the work by failing to inspect materials and work with reasonable promptness. An inspector is placed on the work to keep the Engineer informed as to its progress and the manner in which it is being done; also, to call the Contractor's attention to any infringements of the contract documents. The Inspector will not act as foreman or perform other duties for the Contractor, not improperly interfere with the management of the work. He will not be authorized to approve or accept any portion of the work. In case of dispute between the Contractor and Inspector as to quality of materials or the manner of performing the work, the Inspector shall have authority to reject materials or suspend the work until the question at issue can be decided by the Engineer. Written notice of the suspension of work will be given to the Engineer and the Contractor.

Upon the failure of Contractor or its Subcontractors to comply with any of the requirements of this Contract (but not limited to quality or safety), the City shall have the authority to stop any portion of the work affected by such failure until such failure is remedied. If the City issues a Stop Work Order, the City shall not be liable for any costs or expenses claimed by Contractor arising out of such issuance. The construction schedule shall not be delayed or extended as a result of the City's issuance of a Stop Work Order.

1.508 Inspection of Work.

- a. The Contractor shall notify the City sufficiently in advance of backfilling or concealing any facilities to permit proper inspection. If any facilities are concealed without approval or consent of the City, the Contractor shall uncover for inspection and recover such facilities, all at his own expense.
- b. The Contractor shall furnish the Engineer with every reasonable facility for ascertaining whether the work is being performed in conformance with the contract documents. At any time before acceptance of the work, upon request of the Engineer, the Contractor shall remove or uncover such portions of the finished work as the Engineer may direct. After examination has been made, the Contractor shall restore such portions of the work to the standard required by the contract documents.
- c. Should it be considered necessary or advisable by the City any time before final acceptance of the entire work to make an examination of work already completed by uncovering the same, the Contractor shall on request promptly furnish all necessary facilities, labor and material. If such work is found to be defective in any important respect, due to fault of the Contractor or his Subcontractors, the Contractor shall defray all expenses of such examination and of satisfactory reconstruction. If, however, such work is found to meet the requirements of the Contract, the actual cost of labor and material necessarily involved in

the examination and replacement, plus fifteen (15) percent of such costs to cover superintendent's, general expenses and profit, shall be allowed the Contractor and he shall in addition, if completion of the work of the entire Contract has been delayed thereby, be granted a suitable extension of time on account of the additional work involved.

1.509 Removal of Defective Work. Any defective work shall be removed and replaced at the Contractor's expense. Should the Contractor fail or refuse to remove defective work when so ordered by the Engineer, the Engineer shall have authority to order the Contractor to suspend further operations, and may withhold payment on estimates until such defective work has been removed and replaced in accordance with the plans and specifications. Continued failure or refusal on the part of the Contractor to correct defective work promptly shall be sufficient cause for the City to declare the contract in default, and to proceed to have the work completed in accordance with Article 1.808.

1.510 Final Inspection. Upon written notification by the Contractor or his authorized representative that the work is completed, the Engineer shall make a final inspection within 10 days of the completion of all work included in the contract. If the work is found not to be in accordance with the contract documents, the Engineer shall provide the Contractor with a "Punch List" of the particular defects to be remedied.

Once the Engineer and Contractor determines the work is completed a written Notice by the Engineer shall be given to the Contractor within 10 days of the completion of all work items.

1.511 Review By City. The City, its authorized representatives and agents shall at all time have access to and be permitted to observe and review all work, materials, equipment, payrolls, personnel records, employment conditions, material invoices, and other relevant data and records pertaining to this Contract, provided, however, that all instructions and approval with respect to the work will be given to the Contractor only by the City through its authorized representatives or agents.

1.512 Quality Control. The contractor shall make every effort to provide control of the workmanship of the project. This shall include but not be limited to the following construction practices.

1. Concrete surfaces of sidewalks, paving, slab on grade and other related concrete work shall be smooth and constructed to the elevations as shown on the plans or as directed by the Engineer. An acceptable construction tolerance shall be agreed upon before work is to begin. The Contractor shall notify the Engineer 72 hours before any work is to begin which will involve concrete finishing.
2. Lines and grades of all pipes, conduits, casing, grading, etc. shall be constructed according to the plans or as directed by the Engineer. An acceptable construction tolerance shall be agreed upon before any pipeline, conduit installation, casing installation, or grading begins.
3. Any damages caused by the contractor are to be addressed in a timely manner. In the event the Contractor has not started to make the necessary repairs or adjustments, the City is hereby authorized to make the repairs or adjustments or to order the work to be done by a third party, the cost of the work to be paid by the Contractor.

SECTION 1-6 - CONTROL OF MATERIALS.

1.601 Source of Supply and Quality Requirements. The materials used on the work shall meet all quality requirements of the contract. In order to expedite the inspection and testing of materials, the Contractor shall notify the Engineer of his proposed sources of materials prior to delivery. At the option of the Engineer, approval of the source or approval of materials at the source prior to delivery may be required. If it is found after trial that sources of supply for previously approved materials do not produce specified products or when conditions are such that the use of unfit materials cannot be prevented except by extraordinary inspection methods, the Contractor shall furnish materials from other sources. Before delivery is started and at any time during the process of preparation and use, the materials shall be subject to the approval of the Engineer.

All materials supplied shall be new and undamaged.

1.602 Storage of Materials. The Contractor shall be responsible for the care and storage of materials delivered on the work or purchased for use thereon. Any material that has been delivered on the work and has become damaged before actual incorporation in the work may be rejected by the Engineer even though it may previously have been accepted. Stored materials shall be so located as to facilitate thorough inspection.

1.603 Unacceptable Materials. All materials not conforming to the requirements of the specifications at the time they are to be used shall be considered as unacceptable and all such materials will be rejected and shall be removed immediately from the site of the work unless otherwise instructed by the Engineer. No rejected material, the defects of which have been corrected, shall be used until approval has been given.

1.604 Guarantee. The Contractor shall guarantee the design, equipment, materials, and workmanship furnished under this Contract to be as specified and to be free from defects during the guarantee period. In addition, the equipment and materials furnished by the Contractor shall be guaranteed to be free from defects in design.

Except as otherwise prescribed by the terms of any special guarantees required by the contract documents, the guarantee period shall begin on the date of formal acceptance by the City and shall end 12 months later.

Upon notification, the Contractor shall promptly make all adjustments, repairs, or replacements which, in the opinion of the Engineer or City, arose out of defects and became necessary during the guarantee period.

The cost of all materials, parts, labor, transportation, supervision, special tools, and supplies required for replacement or repair of parts and for correction of defects shall be paid by the Contractor or by the surety.

This guarantee shall be extended to cover all repairs and replacements furnished under the guarantee, including repair for ditch settlement, and the period of the guarantee for each such repair or replacement shall be 12 months after installation or the end of the project guarantee period, whichever is later, except as otherwise prescribed by the terms of any special guarantees required by the contract documents.

If within 10 days after the City has notified the Contractor of a defect, failure, or abnormality in the work, the Contractor has not started to make the necessary repairs or adjustments, the City is hereby authorized to make the repairs or adjustments or to order the work to be done by a third party, the cost of the work to be paid by the Contractor.

In the event of an emergency where, in the judgment of the City, delay would cause serious loss or damage, repairs or adjustments may be made by the City, or a third party chosen by the City, without advance notice to the Contractor and the cost of the work shall be paid by the Contractor or by the surety.

The acceptance of the installation, or any part of it, shall not act to waive this liability on the part of the Contractor.

1.605 "Or Equal" Clause. Whenever, in any section of the contract documents, plans or specifications, any article, materials, or equipment is defined by describing a proprietary product or by using the name of a manufacturer or vendor, the term "or approval equal", if not inserted, shall be implied. The specified article, material, or equipment mentioned shall be understood as indicating the type, function, minimum standard or design, efficiency and quality desired, and shall not be construed in such a manner as to exclude manufacturer's products of comparable quality, design and efficiency. The Engineer shall determine the acceptability of articles, materials or equipment proposed as equals.

1.606 Shop Drawings. The Contractor shall submit for review and approval all shop drawings as indicated in these specifications before the beginning of construction. Failure to submit shop drawings shall suspend payment of any materials delivered or installed. This includes delivery of materials in storage. These requirements will be strictly enforced.

SECTION 1-7 - LEGAL RELATIONS AND RESPONSIBILITY TO THE PUBLIC

1.701 Laws to be Observed. The Contractor shall keep himself fully informed of, and at all times, shall observe and comply with all federal and state laws, all local bylaws, ordinances, and regulations, and all orders and decrees of bodies or tribunals having any jurisdiction or authority, which in any manner affect those engaged or employed on the work, or which in any way affect the conduct of the work. The Contractor shall protect and indemnify the City and its representatives against any claim or liability arising from or based on the violation of any such law, ordinance, regulation, order, or decree, whether by himself or his employees. It shall be the responsibility of the Contractor to provide all safeguards, safety devices and protective equipment and to take any other needed actions as are reasonably necessary to protect the life and health of employees on the project.

Work Eligibility Status. As required under Nebraska LB 403 for any contract entered into after October 1, 2009 the Contractor must register and use a federal immigration verification system, such as the E-Verify Program or an equivalent federal program designated by the United States Department of Homeland Security or other federal agency authorized to verify the work eligibility of a newly hired employee pursuant to the Immigration Reform and Control Act of 1986, to determine the work eligibility status of new employees physically performing services within the State of Nebraska.

1.702 Fair Labor Standards. The Contractor agrees to comply with all current applicable State, Federal, and City fair labor standards in the execution of the contract.

1.703 Permits. The Contractor shall procure and pay for all permits, licenses and bonds necessary for the execution of his work and/or required for municipal, state and federal regulations and laws.

1.704 Restoration of Surfaces Opened by Permit. Upon the presentation of a duly authorized and satisfactory permit from the City, which provides that all necessary repair work will be paid for by the party to whom such permit is issued, the Engineer may authorize the Contractor to allow parties bearing such permits to make openings in the street. The Contractor shall make in an acceptable manner all necessary repairs due to such openings, and such necessary work ordered by the Engineer shall be paid for as provided in these specifications.

1.705 Safety, Health and Sanitation. In the performance of his contract, the Contractor shall comply with all applicable federal, state and local laws governing safety, health and sanitation.

- a. The Contractor shall exercise proper precaution at all time for the protection of persons and property and shall be responsible for all damages to persons or property either on or off the site, which occur as a result of his prosecution of the work. The safety provisions of applicable laws and building and construction codes and OSHA shall be observed, and the Contractor shall take or cause to be taken such additional safety and health measures as the City may determine to be reasonably necessary. Machinery, equipment and all hazards shall be guarded in accordance with the safety provisions of the "Manual of Accident Prevention in Construction," published by the Associated General Contractors of America, Inc., to the extent that such provisions are not in conflict with applicable local laws. The Contractor shall comply with the latest edition of Part VI of the Manual on Uniform Traffic Control Devices. The Contractor shall install plastic fence on open holes when directed by the Inspector. The Contractor shall wear hard hats and safety glasses at all times on the construction site.
- b. The Contractor shall maintain an accurate record all cases of death, occupational disease, or injury requiring medical attention or causing loss of time from work, arising out of and in the course of employment on work under the Contract. The Contractor shall promptly furnish the City with reports concerning these matters.
- c. The Contractor shall indemnify and hold harmless the City and the Engineer and their agents and employees from and against all claims, damages, losses and expenses including attorney's fees arising out of or resulting from the performance of the work, provided that any such claim, damage, loss or expense 1) is attributed to bodily injury, sickness, disease or death, or to injury to or destruction of tangible property (other than the work itself) including the loss of use resulting therefrom, and 2) is caused in whole or in part by any negligent act or omission of the Contractor, any Subcontractor, anyone directly or indirectly employed by any of them or anyone for whose acts any of them may be liable, regardless of whether or not it is caused in part by a party indemnified hereunder.

In any and all claims against the City or the Engineer or any of their agents or employees by any employee of the Contractor, any Subcontractor, anyone directly or indirectly employed by any of them or anyone for whose acts any of them may be liable, the indemnification obligation under this paragraph "c" shall not be limited in any way by any limitation on the amount or type of damages, compensation or benefits payable by or for the Contractor or any Subcontractor under Workmen's Compensation acts, disability benefit acts or employee benefit acts.

The obligation of the Contractor under this paragraph "c" shall not extend to the liability of the Engineer, his agents or employees arising out of 1) the preparation or approval of maps, drawings, opinions, reports, surveys, Change Orders, designs or specifications, or 2) the giving of or failure to give directions or instructions by the Engineer, his agents or employees provided such giving or failure to give is the primary cause of the injury or damage.

The Contractor shall immediately correct any unsafe conditions identified by the City. In the event the Contractor fails to immediately correct such unsafe conditions, the City may either have the unsafe conditions corrected by others at the Contractor's expense, or direct that the work be stopped in the area of the unsafe condition; however, this right to stop/suspend the work shall not give rise to any duty on the part of the City to exercise this right.

The Contractor waives the right to bring claim for damages against the City or Engineer for the correction of unsafe conditions or work stoppages in connection with the Contractor's Safety, Health, and Accident Prevention Program or such program of another contractor. If such a claim against the City or Engineer is brought by a third party, the Contractor shall indemnify and defend the City or Engineer against such claim. The Contractor shall submit to City of Hastings a current copy of the company safety manual before starting work.

1.706 Claims for Labor and Materials. The Contractor shall indemnify and save harmless the City and the Nebraska Department of Transportation from all claims for labor and materials furnished under this contract. When requested by the City, the Contractor shall submit satisfactory evidence that all persons, items, or corporation who have done work or furnished materials under this contract, for which the City or the Nebraska Department of Transportation may have become liable under the laws of the State, have been fully paid or satisfactorily secured. In case such evidence is not furnished or is not satisfactory, an amount will be retained from money due the Contractor which, in addition to any other sums that may be retained, will be sufficient, in the opinion of the City, to meet all claims of the persons, firms, and corporations as aforesaid. Such sum shall be retained until the liabilities as aforesaid are fully discharged or satisfactorily secured.

1.707 Contractor's Insurance Coverage. The Contractor shall not commence work under this Contract until Contractor has obtained all the insurance required under this article. Furthermore, the Contractor shall not allow any sub-contractor to commence work under this Contract until the sub-contractor has obtained the same insurance as is required of the Contractor. The sub-contractor alone shall be responsible for the sufficiency of its own insurance program.

Certificates of Insurance. Certificates of Insurance acceptable to the City shall be filed with the City prior to commencement of the work. These Certificates shall contain a provision that coverages afforded under the policies will not be canceled, or materially altered, until at least 30

days prior written notice has been given to the City. All insurance carried shall conform to the relevant provisions of the respective Project Documents and be with insurance companies which are rated “A - VII” or better by Best’s Insurance Guide, or other insurance companies of recognized responsibility satisfactory to the City.

Additional Insureds. Insurance coverages furnished under this Contract, with the exception of Workers' Compensation and Employer's Liability, shall include the City of Hastings, the Nebraska Department of Transportation, and the City of Hastings’ and the Nebraska Department of Transportations’ partners, directors, officers, agents, and employees as Additional Insureds on a primary and noncontributory basis, and shall include Products and completed operations with respect to the activities of the Contractor and shall be maintained for the full duration of the project including for a period of three (3) years after final acceptance and payment .

Notwithstanding any other provision of these policies, the insurance afforded shall apply separately to each insured, with respect to any claim, suit, or judgment made or brought by or for any other insured, as though a separate policy had been issued to each, except the insurer's liability shall not be increased beyond the amount or amounts for which the insurer would have been liable had only one insured been named.

The City and Nebraska Department of Transportation shall not by reason of their inclusion under these policies incur liability to the insurance carrier for payment of premium for these policies.

Waiver Of Subrogation. The Contractor and their sub-contractor shall require their insurance carriers, with respect to all insurance policies, to waive all rights of subrogation against the City, the Nebraska Department of Transportation, and the City’s and the Nebraska Department of Transportation’s partners, directors, officers, agents, and employees.

Workers' Compensation And Employer's Liability Insurance. The Contractor shall procure, and shall maintain during the life of this Contract, Workers' Compensation Insurance as required by workers' compensation laws of the State of Nebraska and also of the state in which the sub-contractor is domiciled.

The Contractor shall also be protected against claims for injury, disease, or death of employees which, for any reason, may not fall within the provisions of a workers' compensation law. The Employer's Liability Insurance shall contain the following limits of liability:

Bodily Injury by Accident	\$500,000 each accident
Bodily Injury by Disease	\$500,000 each employee
Bodily Injury by Disease	\$500,000 policy limit

General Liability Insurance. This insurance shall be written per project on an “occurrence” policy form, including coverage for premises/operations, products/completed operations, broad form property damage, blanket contractual liability, independent contractor’s and personal injury, with no exclusions for explosion, sudden and accidental pollution or an absolute or total pollution exclusion, collapse and underground perils. The commercial general liability policy shall also include a severability of interest clause and a cross liability clause in the event more than one entity is “named insured” under the liability policy. If applicable, this policy shall also be endorsed to include railroad protective with limits no less than replacement cost of the value

of any real property covered under any rail agreement entered into by the City. If work is being done near a railroad track, the 50' railroad right of way exclusion must be deleted.

Limits of Insurance shall be as follows:

Each Occurrence Limit	\$1,000,000
Products/Completed Operations	\$2,000,000
General Aggregate Limit	\$2,000,000
Personal and Advertising Injury	\$1,000,000

Pollution Liability – (If Applicable).

Limits of at least: \$1,000,000 per occurrence; \$2,000,000 aggregate

If Contractor or its Sub-subcontractor's work includes but not limited to remediating, handling, processing or disposing of hazardous material including but not limited to asbestos containing materials, silica, lead, PCBs, contaminated soil, etc, coverage shall be provided for bodily injury, property damage and clean-up costs resulting for pollution conditions.

Riggers Liability – (If applicable). Should work involve the moving, lifting, lowering, rigging or hoisting of property or equipment Contractor shall carry Rigger's Liability Insurance to insure against physical loss or damage to the property or equipment on a Replacement Cost Basis

Automobile Liability Insurance. This insurance shall be written under a Business Auto Policy and shall protect the Contractor and Additional Insureds against claims arising from injuries to members of the public or damage to property of others arising from the use of automobiles whether such automobiles are owned, non-owned, or hired. Automobile insurance shall include Motor Carrier Endorsement Act MCS 90 and transportation pollution coverage if applicable. If work is being done near a railroad track, the 50' railroad right of way exclusion must be deleted. **Automobile liability coverage shall be obtained from an insurance carrier who is licensed with the Nebraska Department of Insurance.**

Limit of Liability \$1,000,000 each accident

Umbrella Liability Policy. This insurance shall protect the Contractor and the Additional Insureds against all claims in excess of the limits provided under the employer's liability, automobile liability, and general liability policies. The liability limits of the umbrella liability policy shall be not less than \$5,000,000 per occurrence. This policy shall be an "occurrence" type policy. However, City reserves the right to require higher limits with respect to each project.

Professional Liability (Applicable for contractors providing or is responsible for providing design/engineering/surveying services/or consulting services):

Limits of at least: \$1,000,000 per occurrence; \$1,000,000 aggregate

Policy shall provide for a retroactive date prior to the starting date of services for which this agreement applies. Policy shall not exclude bodily injury, property damage, or pollution liability. Coverage shall remain in force for a minimum of 3 years following substantial completion of

construction through either policy renewal or the purchase of an Extended Reporting Provision. Contractor agrees to waive its rights of recovery. Subcontractor's insurer shall endorse the policy to waive subrogation against Owner and their respective agents, officers, directors and employees.

Transportation Insurance. Contractor shall purchase inland marine coverage at the expense of Contractor on all equipment and materials, where City has an insurable interest. Insurance shall protect for Contractor and City from physical loss of equipment while loading, unloading, in transit to jobsite, and until equipment or materials have been installed or received by City.

Proof of Carriage of Insurance. Satisfactory certificates of insurance shall be filed with the City prior to starting any construction work on this contract. The certificates shall state that thirty (30) days written notice shall be given to the City before any policy covered thereby is changed or canceled.

Indemnification. To the fullest extent permitted by laws and regulations, the Contractor shall defend, indemnify, and hold harmless the City, the Nebraska Department of Transportation, and the City's and the Nebraska Department of Transportation's officers, directors, partners, consultants, agents, and employees from and against all claims, damages, losses, and expenses, direct, indirect, or consequential (including but not limited to fees and charges of engineers, architects, attorneys, and other professionals and court and arbitration costs) arising out of or resulting from the performance of the work by the Contractor, any sub-contractor, any person or organization directly or indirectly employed by any of them to perform or furnish any of the work, or anyone for whose acts any of them may be liable, regardless of whether or not it is caused in part by a party indemnified hereunder or arises by or is imposed by law and regulations regardless of the negligence of any such party.

In any and all claims against the City, the Nebraska Department of Transportation, or any of the City's or the Nebraska Department of Transportation's officers, directors, partners, consultants, agents, or employees by any employee of the Contractor, any sub-contractor, any person or organization directly or indirectly employed by any of them to perform or furnish any of the work or anyone for whose acts any of them may be liable, this indemnification obligation shall not be limited in any way by any limitation on the amount or type of damages, compensation, or benefits payable by or for the Contractor or any such sub-contractor or other person or organization under workers' or workmen's compensation acts, disability benefit acts, or other employee benefit acts, nor shall this indemnification obligation be limited in any way by any limitation on the amount or type of insurance coverage provided by the City, the Contractor, or any of their sub-contractors.

Property Insurance A.K.A. Builder's Risk. Unless otherwise provided, the CONTRACTOR shall purchase and maintain property insurance, a.k.a. builder's risk insurance, on the building construction project in amount thereto for entire work at site on a replacement cost basis. Such property insurance shall be maintained, unless otherwise provided in contract documents or otherwise agreed in writing by all persons and entities who are beneficiaries of such insurance, until final acceptance of work by OWNERS. Insurance shall include interests of OWNERS, CONTRACTOR, SUBCONTRACTOR, and sub-subcontractors in work. This property

insurance covering work will have deductible for each occurrence, which will be responsibility of CONTRACTOR.

Before an exposure to loss may occur, the CONTRACTOR will provide a copy of the property insurance policy or evidence of property insurance, upon request that includes all property insurance coverages. The CONTRACTOR will not cancel or allow such policy to expire without written notice to the other.

Waivers of Subrogation: OWNER and CONTRACTOR and all SUBCONTRACTORS waive all rights against

(1) each other and any of their subcontractors, sub-subcontractors, agents and employees, each of the other, and (2) OWNER'S or CONTRACTOR'S consultants, separate contractors, if any, and any of their subcontractors, sub-subcontractors, agents and employees, for damages caused by fire or other perils to extent covered by property insurance obtained, or other property insurance applicable to work, except such rights as they have to proceeds of such insurance held by OWNER and/or CONTRACTOR as fiduciary. OWNER and/or CONTRACTOR, as appropriate, shall require of OWNER'S and/or CONTRACTOR'S consultants, separate contractors, if any, and subcontractors, sub-subcontractors, agents and employees of any of them, by appropriate agreements, written where legally required for validity, similar waivers each in favor of other parties enumerated herein. Policies shall provide such waivers of subrogation by endorsement or otherwise. A waiver of subrogation shall be effective as to a person or entity even though that person or entity would otherwise have a duty of indemnification, contractual or otherwise, did not pay insurance premium directly or indirectly and whether or not person or entity had an insurable interest in property damaged.

1.708 Contractor's Responsibility for Utility Property and Services. At points where the Contractor's operations are adjacent to properties of railway, telephone and power companies, or are adjacent to other property, to which damage might result, work shall not be commenced until all arrangements necessary for the protection thereof have been made.

The Contractor shall cooperate with any of the City's underground or overhead utility lines in their removal and rearrangement operations in order that these operations may progress in a reasonable manner, and that duplication of rearrangement work may be reduced to a minimum, and that services rendered by those parties will not be unnecessarily interrupted.

In the event of interruption to water or utility services as a result of accidental breakage, or as a result of being exposed or unsupported, the Contractor shall promptly notify the proper authority. He shall cooperate with the said authority in the restoration of service as promptly as possible.

In no case shall interruption to water service be allowed to exist outside of working hours. Fire hydrants shall be kept accessible to the Fire Department at all times and no materials shall be kept or stockpiled within fifteen (15) feet of any fire hydrant.

The Contractor must cooperate with the utility companies and schedule his work in such a manner as to protect the existing utility facilities until the facilities are abandoned or replacement facilities are completed. In instances where partial grading is necessary before a utility can

install its facilities, the Contractor shall consult with the utility and plan the work so that reasonable time can be allowed the utility for completing its work.

Contractor shall exercise particular care at all times to avoid damage to any of City of Hastings system or other facilities and equipment located at or near the scene of any part of the work, especially such facilities as may be in operation. Any costs for potholing prior to boring are considered subsidiary to the bid.

Contractor specifically acknowledges that it shall be responsible and liable to City of Hastings for all injury or damage to any such existing and operating facilities, including loss of gas or product and all repairs necessitated by any act or omission, resulting in such damages, on the part of the Contractor, his agents or employees, or any subcontractor or subcontractor's agents of employees.

Contractor shall also exercise particular care at all times to avoid damage to underground structures and lines, and specifically recognizes that it shall be held responsible for any injury or damage to unmarked or unidentified underground structures or pipelines, done by Contractor's personnel, or any subcontractor's personnel in connection with performance of the work hereunder.

Please note before beginning any excavation, the Contractor shall be responsible for contacting Diggers Hotline at 1-800-331-5666 or call 811.

1.709 No Waiver of Legal Rights. The City shall not be precluded or estopped by any measurement, estimate, or certificate made either before or after the completion and acceptance of the work and payment therefore, from showing the true amount and character of the work performed and materials furnished by the Contractor, nor from showing that any such measurement, estimate, or certificate is untrue or is incorrectly made, nor that the work or materials do not, in fact, conform to the contract. The City shall not be precluded or estopped, notwithstanding any such measurement, estimate or certificate and payment in accordance therewith, from recovering from the Contractor or his sureties, or both, such damage as it may sustain by reason of his failure to comply with the terms of the contract. Neither the acceptance by the City, nor any representative of the City, nor any payment for or acceptance of the whole or any part of the work, nor any extension of time, nor any possession taken by the City, shall operate as a waiver of any portion of the contract or of any power herein reserved, or of any right to damages. A waiver of any breach of the contract shall not be held to be a waiver of any other or subsequent breach.

1.710 Warranty of Title. No material, supplies or equipment to be installed or furnished under this Contract shall be purchased subject to any chattel mortgage or under a conditional sale, lease-purchase or other agreement by which an interest therein or in any part thereof is retained by the seller or supplier. The Contractor shall warrant good title to all materials, supplies, and equipment installed or incorporated in the work and upon completion of all work, shall deliver the same together with all improvements and appurtenances constructed, or placed thereon, by him to the City free from any claims, liens or charges. Neither the Contractor nor any person, firm or corporation furnishing any material or labor for any work covered by this Contract shall have any right to a lien upon any improvement or appurtenance thereon.

Nothing contained in this paragraph, however, shall defect or impair the right of persons furnishing materials or labor under any law permitting such persons to look to funds due the Contractor in the hands of the City. The provisions of this paragraph shall be inserted in all subcontracts and material contracts and notice of its provisions shall be given to all persons furnishing materials for the work when no formal contract is entered into for such materials.

1.711 Jurisdiction. Any action in court against the Contractor or sureties on his bond, because of damages to property or individual by said Contractor, or his workmen, or because of the violation of any provision of the specifications, or on account of the failure of the Contractor to fully comply with this provision, shall be brought in the District Court of the State of Nebraska in and for Adams County.

1.712 Care of Work.

- a. The Contractor shall be responsible for all damages to person or property that occur as a result of his fault or negligence in connection with the prosecution of the work and shall be responsible for the proper care and protection of all materials delivered and work performed until completion and final acceptance, whether or not the same has been covered in whole or in part by payments made by the City.
- b. The Contractor shall provide sufficient competent watchmen, both day and night, including Saturdays, Sundays, and holidays, from the time the work is commenced until final completion and acceptance.
- c. In an emergency affecting the safety of life, limb or property, including adjoining property, the Contractor, without special instructions or authorization from the City, is authorized to act at his discretion to prevent such threatened loss or injury and he shall so act. He shall likewise act if instructed to do so by the City. Any compensation claimed by the Contractor on account of such emergency work will be determined by the City as provided in Section 1.404 hereof.
- d. The Contractor shall avoid damage as a result of his operations to existing sidewalks, streets, curbs, pavements, utilities (except those which are to be replaced or removed), adjoining property, etc., and he shall at his own expense completely repair any damage thereto caused by his operations. The contractor shall be responsible for resolving claims concerning damage to local roads caused by their operation.
- e. The Contractor shall shore up, brace, underpin, secure, and protect as may be necessary, all foundations and other parts of existing structures adjacent to, adjoining, and in the vicinity of the site, which may be in any way affected by the excavations or connected with the demolition and/or site clearance of the work embraced in this Contract. The Contractor shall be responsible for the giving of any and all required notices to any adjoining or adjacent property City, public & private utility companies, or other party before the commencement of any work. The Contractor shall indemnify and save harmless the City from any damages on account of settlements or the loss of lateral support of adjoining property and from all loss or

expense and from all damages for which the City may become liable in consequence of such injury or damage to adjoining and adjacent structures and their premises.

SECTION 1-8 - EXECUTION AND PROGRESS

1.801 Subletting or Assigning or Contract. The Contractor will not be permitted to sublet, assign, sell, transfer or otherwise dispose of the contract or any portion thereof, or his right, title, or interest therein; or to either legally or equitably assign any of the money payable under his contract, or his claim thereto, without the written consent of his surety and the Engineer. The Contractor will not be relieved of any responsibility through any of the above actions.

- a. The Contractor shall be as fully responsible to the City for the acts and omissions of his subcontractors, and of persons either directly or indirectly employed by them, as he is for the acts and omissions of persons directly employed by him.
- b. Nothing contained in the Contract shall create any contractual relation between any subcontractors and the City.

1.802 Execution of Work. The proposal for each project will show the project period. The progress of the work shall be at a rate sufficient to complete the project within the project period. If it appears that the rate of progress is such that the project will not be completed within the project period, or if the work is not being executed in a satisfactory and workmanlike manner, the City may order the Contractor to take such steps as it considers necessary to complete the project within the period of time specified, or execute the work in a satisfactory manner.

1.803 Limitation of Operations. The Contractor shall conduct the work at all times in such a manner and in such sequence as will insure the least interference with traffic. He shall have due regard to the location of detours and to the provisions for handling traffic. He shall not open up work to the prejudice of work already started, and the Engineer may require the Contractor to finish a section on which work is in progress before work is started on any additional section. The Contractor shall so conduct his operations and maintain the work in such condition that adequate drainage shall be in effect at all times.

1.804 Methods and Equipment. The methods, equipment and appliances used shall produce a satisfactory quality of work, and shall be adequate to maintain the schedule of progress specified. Equipment used on any portion of the project shall be such that no injury to the roadway, adjacent property, or other streets will result from its use.

When the methods and equipment to be used by the Contractor in accomplishing the construction are not prescribed in the contract, the Contractor is free to use any methods or equipment that he demonstrates, to the satisfaction of the Engineer, will accomplish the contract work in conformity with the requirements of the contract.

1.805 Temporary Suspension of Work. Work shall be suspended wholly or in part when, in the opinion of the Engineer, weather or other conditions are unfavorable to its satisfactory prosecution. Work shall also be suspended at the direction of the Engineer pending settlement or disputes arising out of failure of the Contractor to comply with the provisions of the contract. Written notice of suspension of work shall be given by the Engineer. When the conditions causing suspension no

longer exist, such written notice shall be given to the Contractor by the Engineer. Promptly after such written notice, the Contractor shall resume prosecution of the work as provided in Article 1.802.

1.806 Liquidated Damages. Time is an essential element of the contract, and it is important that the work be pressed vigorously to completion.

For each working day that any work shall remain uncompleted either after the end of each project period or at the end of the contract completion date, the amount per working day specified in the proposal form will be assessed, not as a penalty but as predetermined and agreed liquidated damages. The City and Contractor specifically agree that the per working day amount to be assessed as liquidated damages is fair and reasonable and not excessive. The parties further agree that said per working day amount accurately reflect the anticipated loss and inconvenience to the public and lost revenue to or use by the City due to the project not being completed by the end of the project period or the end of the contract completion date. The City will prepare and forward to the Contractor an invoice for such liquidated damages. The final payment will be withheld by the City until the invoice is paid by the Contractor.

Due account shall be taken of any adjustment of the project period or the contract completion date granted under Article 1.807.

The assessment of liquidated damages for failure to complete the work either within each project period or the contract completion date shall not constitute a waiver of the City's right to collect for any additional damages which the City may sustain by failure of the Contractor to carry out the terms of its contract.

1.807 Extension of Project Period or Contract Completion Date. An extension of the project period or contract completion date may be granted only in writing by the City for any of the following reasons:

1. Additional work resulting from a modification of the plans for the project.
2. Delays caused by the City.
3. Other reasons beyond the control of the Contractor, which in the City's judgment would justify such extension.

No extension of project period or contract completion date will be allowed for variations between contract quantities and actual quantities which cannot be predetermined and which amount to less than twenty percent (20%) of the contract quantities unless approved by the Engineer.

1.808 Abrogation. If the Contractor abandons the work under this contract, sublets it or assigns it without the consent of the city, or if he fails to give his personal attention to it, or if it is the Engineer's opinion that he has unnecessarily or unreasonably delays or neglected the work or any part of it, written notice to that effect is to be given to the Contractor by the Engineer. After such notice, no materials or equipment shall be removed from the work. If, within five (5) days thereafter, the Contractor does not take steps which, in the judgment of the Engineer, will insure the satisfactory completion of the work, then the City may declare this contract null and void and the security forfeited and may notify the Contractor in written to discontinue the work or any part of it; thereupon ceases the Contractor's right or possession of the ground and of all materials and equipment thereon. The City then, at its option, may enter upon and take possession of the work with all material, supplies, and

equipment remaining thereon and by contract or otherwise, as the City may determine, may complete the work or the part of it designated, and charge the expense thereof to the Contractor using any materials or equipment found on the site. The expense so charged, together with all damages incurred, will be deducted from any funds due to become due under this contract, and should the unexpended balance of these funds be insufficient, the excess shall be at the cost of the Contractor and the sureties on the Contractor's bond. Neither completion of a part of the work nor the extension for any reason of the time of the completion of the work is to be considered a waiver of this right to abrogate the contract for abandonment, delay or unsatisfactory work.

1.809 Termination of Contractor's Responsibility. The contract shall be considered completed when the work has been accepted in writing by the City. Such acceptance shall release the Contractor from all further obligation with respect thereto, except as to conditions and requirements set forth in his bond.

1.810 Assignment or Novation. The Contractor shall not assign or transfer, any of its rights, duties, benefits, obligations, liabilities, or responsibilities under this Contract without the written consent of the City, provided, however, that assignments to banks, trust companies, or other financial institutions may be made without the consent of the City. No assignment or novation of this Contract shall be valid unless the assignment or novation expressly provides that the assignment of any of the Contractor's rights or benefits under the Contract is subject to a prior lien for labor performed, services rendered, and materials, tools, and equipment supplied for the performance of the work under this Contract in favor of all persons, firms or corporations rendering such labor or services or supplying such materials, tools, or equipment.

1.811 Disputes.

- a. All disputes arising under this Contract or its interpretation, whether involving law or fact or both, or extra work, and all claims for alleged breach of Contract shall within ten (10) days of commencement of the dispute be presented by the Contractor to the City for decision. All papers pertaining to claims shall be filed in quadruplicate. Such notice need not detail the amount of the claim but shall state the facts surrounding the claim in sufficient detail to identify the claim, together with its character and scope. In the meantime, the Contractor shall proceed with the work as directed. Any claim not presented within the time limit specified in this paragraph shall be deemed to have been waived, except if the claim is of a continuing character and notice of the claim is not given within ten (10) days of its commencement, the claim will be considered only for a period commencing ten (10) days prior to the receipt by the City of notice thereof.
- b. The Contractor shall submit in detail his claim and his proof thereof. Each decision by the governing body of the City will be in writing and will be mailed to the Contractor by registered or certified mail, return receipt requested, directed to his last known address.
- c. If the Contractor does not agree with any decision of the City, he shall in no case allow the dispute to delay the work but shall notify the City promptly that he is proceeding with the work under protest and he may then accept the matter in question from the final release.

SECTION 1-9 - MEASUREMENT AND PAYMENT

1.901 Payments. The City, at its discretion, may include in such monthly estimates payments for materials that will eventually be incorporated in the project, provided that such materials are suitably stored on the site of the project at the time of preparing estimates for payment. Such payment is to be based upon the estimated value thereof as ascertained by the Engineer. Such material when so paid for by the City shall not be removed from the project without consent of the City and, in case of default on the part of the Contractor, the City may use or cause to be used by others these materials in construction of the project.

The City will retain five percent (5%) of the total contract amount for all work completed including change orders.

Payment of the retainage will be made within forty-five (45) days after project is substantially complete, provided the Contractor submits a Letter of Credit for 125% of the uncompleted work. Substantial completion will include water mains passing biological testing and placed into service. Sewer mains shall pass pressure testing and be televised with receipt of the inspection report.

The bid proposal price sheets include any and all work for each project. Any requirement shown in the drawings, but not listed separately in the proposal price sheets, are considered subsidiary to the work. This includes but is not limited to abandonments of existing utilities and any potholing required for utility locates prior to boring.

1.902 Payments Withheld. The City may withhold or, on account of subsequently discovered evidence, nullify the whole or a part of any certificate to such extent as may be necessary to protect itself from loss on account of:

1. Defective work not remedied.
2. Claims filed or reasonable evidence indicating probable filing of claims.
3. Failure of the Contractor to make payments properly to subcontractors for material or labor.
4. A reasonable doubt that the contract can be completed for the balance then unpaid.
5. Damage to another Contractor.
6. Damage to public or private property.

When the above grounds are removed, payment shall be made for amounts withheld because of them.

1.903 Acceptance, Final Payment, and Release of Liability. If final inspection reveals that all details of the work have been completed to his satisfaction, the Engineer shall tentatively accept

the work, in writing, relieving the Contractor of further responsibility for the care and maintenance of the completed work and, provided that all equipment and materials have been removed from the right-of-way, shall also relieve the Contractor of further public liability. As soon as possible after tentative acceptance of the work, the Engineer shall measure the completed work and compute the quantities of work for which payment is to be made. Before final settlement is made, the City shall be satisfied with the completed work. When the Engineer is satisfied that all items of the work have been found to be consistent with the terms of the contract and specifications, a final estimate, including the retained percentage due the Contractor, shall be released for payment. Release of the final estimate shall constitute formal acceptance of the work. Acceptance by the Contractor of the final payment shall constitute release of the City and each of its officers and agents from any additional claim or liability hereunder for any act or negligence of the City or of any other person.

All prior partial estimates and payments shall be subject to correction in the final estimate and payment.

1.904 Payment for Extra Work. The Contractor will receive and accept payment for work performed under this contract as follows:

- a. Work Performed as Stipulated in the Contract. For all items of work performed which are covered by definite unit prices or lump sum amounts specified in the contract, the Contractor shall receive and accept compensation at the rate specified in the contract.
- b. Extra Work. Extra work ordered by the Engineer, of a quality or class not covered by the contract, will be paid for at an agreed price. For extra work ordered by the Engineer and performed on an agreed price basis, the Engineer and the Contractor shall enter into a written agreement before such work is undertaken. This agreement shall describe the extra work that is to be done and shall specify the agreed price or prices therefore.

END OF SECTION

SECTION 2 SPECIAL PROVISIONS

SECTION 2-0 - GENERAL

2.001 General Provisions. The general conditions are general in scope and may refer to conditions not encountered on the work covered by this contract. Any provisions of the General Provisions which pertains to a nonexistent condition and is not applicable to the work to be performed hereunder, or which conflicts with any provision of the Special Provisions shall have no meaning to the contract and shall be disregarded.

2.002 Purchasing Agent Appointment and Exempt Sales Certificate. The Contractor performing the work under this contract will be issued a “Purchasing Agent Appointment” and “Exempt Sales Certificate” signed by the authorized representative of the Owner. It is to be used by the Contractor when purchasing tangible personal property to be actually incorporated into the contract work.

2.003 Maintenance of Traffic. The Contractor shall conduct their work so as to interfere as little as possible with public travel, whether vehicular or pedestrian. Whenever it is necessary to cross, obstruct or close roads, driveways and walks, whether public or private, the Contractor shall, at their own expense, provide and maintain suitable and safe bridges, detours, or other temporary expedients for the accommodation of public and private travel, and shall give reasonable notice to owners of private drives before interfering with them. Such maintenance of travel will not be required when the Contractor has obtained permission from the owner or tenant or private property, or from the authority having jurisdiction over public property involved, to obstruct traffic at the designed area.

2.004 Provisions for Traffic Control and/or Barricading. The Contractor shall provide barricades and maintain a means of traffic control applicable to work site conditions. The means of traffic control and barricade(s) type(s) shall be approved by City of Hastings inspector and by appropriate agency on which work is occurring, being either or combination of city, county, or state right-of-way.

The Contractor shall provide all approved barricades with lights and furnish flagmen as required. Contractor shall provide daily maintenance on all barricades, flashers, etc., during course of construction. A person will be designated by Contractor that is in their employment to be responsible for daily maintenance and shall be available 24 hours a day, seven days a week and will have a telephone number given to City of Hastings and appropriate governing agency on whose right-of-way project is taking place.

Traffic Control shall be considered subsidiary to the project and no direct payment shall be paid for this work.

2.005 Street Closing. In the event it is deemed necessary for the Contractor to close any streets during the execution of work, the Contractor shall notify the owner of such street closing 48 hours in advance, prior to any street closing due to open cut street crossing, and shall notify all vital departments to include police, fire, ambulance, sheriff, street, and engineering Departments.

SECTION 2 – SPECIAL PROVISIONS

2.006 Dust Control. The Contractor shall be required to keep dusty conditions, caused by construction, from being a source of complaint by adjacent property owners by watering down haul routes or by other methods approved by the Engineer.

2.007 Removal of Trees, Hedges, Shrubs, and/or Fences. The Contractor shall sufficiently plan ahead to notify property owner(s) of any obstacles in the way of proposed construction that will have to be removed prior to construction by property owners if they desire to save such.

Clearing and removal of items will be shown on plans and completed by Contractor. The payment for removal of said items will be on proposal sheet, however, any tree with a diameter of 6" or less, all shrubs and bushes will be considered subsidiary to work and no additional compensation will be paid. The Contractor shall not remove any trees in the project area without prior approval of City of Hastings.

The Contractor will be required to reimburse the public for any damage to trees which is not authorized by City of Hastings.

2.008 Shutdown, Valve Operation. Shutdowns will be made only by City of Hastings Utilities Department personnel. In the event that an emergency condition warrants, the Contractor shall take direct action to make shutdown but must notify City of Hastings Utilities Department immediately and remain on worksite to demonstrate what has taken place to City of Hastings Utilities Department personnel.

All shutdowns, unless emergency, will be scheduled in advance and shall be the responsibility of the Contractor to notify residences and/or businesses effected and give estimated time of return of service.

2.009 Water. The Owner will provide access to the Contractor of any and all water necessary to construct the proposed project. The water will be furnished from the fire hydrant nearest the project. It will be the responsibility of the Contractor to contact Hastings Utilities before use of any fire hydrant. Hastings Utilities will, upon deposit from the Contractor, furnish and install a meter, check valve and shut-off for the Contractor's use. The Contractor shall furnish all other necessary hose adaptors, hose and other equipment for the distribution and transportation of the water and shall be responsible for water usage fees.

2.010 Maintenance of Surface Drainage and Storm Sewers. During the course of construction, the Contractor shall conduct operations in a manner that will not pond or divert surface drainage onto private property and shall maintain the existing surface drainage patterns until such time that the storm sewer system is operable. In addition, the Contractor shall provide temporary works construction which must be approved by the Engineer and shall remain in place until such time that the storm sewer system is operable. The work required for maintenance of surface drainage and storm sewers will not be paid for directly but shall be considered subsidiary to the bid items of the contract.

SECTION 2 – SPECIAL PROVISIONS

2.011 Testing. All materials will be inspected, tested and accepted by the Engineer before incorporated in the work. Any work in which untested and unaccepted materials are used without approval or written permission of the Engineer shall be performed at the Contractor's risk and may be considered as unacceptable and unauthorized and will not be paid for. Unless otherwise designated, tests in accordance with the most recent cited standard method of AASHTO or ASTM, whichever are current on the date of advertisement, will be at the expense of the Contractor. All testing (concrete and subgrade) will be taken by the Engineer or a qualified representative of the Owner. The cost of concrete tests (compressive cylinder breaks) will be the responsibility of the Owner. All materials being used are subject to inspection, test or rejection at any time prior to incorporation into the work. Copies of such tests will be furnished to the Contractor at their request.

2.012 Concrete Mix Type. Cement and aggregates not on the latest edition of the Nebraska Department of Transportation's "Approved Product List" shall not be used without permission from the City Engineer. All Portland Cement Concrete (PCC) shall be NDOT approved Type 1P, 1S or 1T. The constituents of PCC and their mixing, handling, and proportioning shall conform to ASTM C94. Concrete not meeting the 28 day required strength shall be removed and replaced at no extra cost to the City. The Engineer may evaluate the concrete's expected use and may allow it to remain in place at 50% pay.

- (a) Concrete mix for PCC pavement, driveways and structural concrete shall be State of Nebraska 47B as specified in Section 1002 of the 2017 State of Nebraska specifications.
- (b) Concrete mix for sidewalks shall be State of Nebraska Type 47-B as specified in Section 1002 of the 2017 State of Nebraska Specifications.
- (c) Recent and certified mill tests of P.C.C. shall be furnished to the City Engineer. Different brands of cement, or the same brand from different mills, shall not be mixed during storage. Neither shall they be used alternately in any one concrete placement without permission from the City Engineer. Contractors supplying concrete shall notify the City Engineer when changing to different cement.
- (d) Cement or Fly Ash shall be protected from damage due to moisture. Cement or Fly Ash so damaged will be rejected. Cement or Fly Ash shall not be in storage at the concrete plant longer than ninety (90) days without retesting for quality testing by an approved testing facility.
- (e) Contractor shall submit a Concrete Mix Design identifying the location of the ready mix or central mix plant, cement manufacturer, type of inter-ground and blended cement, type of admixtures, aggregate gradation, aggregate pit and quarry location.
- (f) Contractor shall submit concrete batch tickets showing batch weights, aggregate moisture (shall be tested daily and moisture probes are allowed), admixtures used, water, and mix design calculations. A copy of the batch ticket shall be provided upon delivery of concrete.

SECTION 2 – SPECIAL PROVISIONS

- (g) Aggregate and concrete quality are subject to approval of the Department. Aggregate shall be free of coatings that will inhibit bond and free from injurious quantities of loam, alkali, organic matter, thin or laminated pieces, paper, wood, chert, or other deleterious substances as determined by the Engineer. The use of aggregate obtained from any reclaiming or recycling process shall not be allowed without permission from the City Engineer. Aggregate from different sources shall not be mixed or stored in the same pile, nor used alternately in the same project or mixed without permission from the City Engineer.
- (h) An engineer approved water-reducing admixture shall be used in all fly ash modified concrete mixes at the dosage rate recommended by the manufacturer. The water-cement ratio of all fly ash modified concrete shall not exceed the limit for the various classes of concrete as shown in Table 1002.02.
- (i) All concrete shall have a minimum compressive strength of 3,500 psi at 28 days unless otherwise noted in the plans and specifications. The 7-day compressive strength should be 70% of the 28-day compressive strength.

2.013 Landfill Fees. The Contractor will be responsible for securing their own disposal site or paying any associated fees for disposal at the Landfill.

2.014 Working Hours. Normal working hours will be considered to be from 8:00 a.m. to 5:00 p.m., Monday through Friday (holidays excepted: New Year's Day, Martin Luther King Day, Memorial Day, Independence Day, Labor Day, Veteran's Day, Thanksgiving, Friday after Thanksgiving, ½ day Christmas Eve, and Christmas Day). Any Contractor desiring other working hours must take exception to specifications for consideration by City of Hastings. Any exception must be approved or negotiated to mutual acceptance by Contractor and City of Hastings, final acceptance will be granted in writing.

2.015 Removal and Replacement of Property Stakes. If it is necessary to remove any property corners or markers during construction operations, the Contractor shall notify the Engineer so that the Engineer can establish reference ties. Any markers removed without notice to the Engineer shall be replaced at the Contractor's expense in accordance with the proper land surveying techniques.

2.016 Removal of Existing Materials. Contractor shall remove all called for materials with care as not to ruin or damage material for further use. Any material required to be removed for reuse and has been damaged by careless and negligent action on part of Contractor, shall constitute cause for replacement or payment by Contractor. Inspection of said material for reuse shall be made at sole discretion of City of Hastings inspector. Any gas services which are removed by Contractor shall be foamed shut by Contractor.

2.017 Existing Sprinkler Systems. Contractor shall be responsible for the repair of existing lawn sprinkler components disturbed by the construction activities. The property owner shall be responsible to show, if possible, the location of the underground line and size as well as sprinkler

SECTION 2 – SPECIAL PROVISIONS

head location. Temporary plugging of line may be incurred by Contractor to keep certain areas operational of sprinkler system. Where sprinklers systems are listed as bid items, they shall be replaced in like kind, including all connectors. All sprinkler lines that will be disturbed during construction, shall be cut and protected as needed.

2.018 Appearance of Construction Area and Storage Site. Contractor will be required to keep the construction area in a neat and orderly fashion that would be considered reasonable in regard to work being completed.

Where sidewalks, driveways, etc., exist, Contractor shall keep them free from debris and will be swept off at the end of the construction day. Storage site will be kept in a neat and orderly manner.

No dirt will be allowed to be piled in the street overnight. Dirt piles on the terrace (or alternate locations) must meet all storm water management requirements.

Where Contractor will have a storage site for materials, equipment, etc., on property owned by City, it shall be kept in a neat and orderly manner, free from debris, accumulation of unused materials, etc. Any area used for storage, etc., shall be properly served from the public by temporary fencing if not within a fenced area.

Debris from job site must be removed same day as taken from street, yard, etc. Piling up of these materials, (i.e., concrete, brush, trees, tree limbs) will not be allowed on site.

2.019 Construction Progress Meetings. Construction progress meetings will be held at a predetermined time each week, time to be chosen at the preconstruction conference. City of Hastings will have in attendance Director of Engineering and Project Engineer and Inspector. Contractor shall have Project Superintendent and job foreman present.

2.020 Final Cleaning Up. Upon completion of the work and before acceptance and final payment, the Contractor shall clean the street, borrow pits and all ground occupied by him in connection with the work of all rubbish, excess materials, false work, temporary structures, and equipment; all parts of the work shall be left in a neat and presentable condition.

2.021 Preconstruction Conference. A preconstruction conference will be held at City of Hastings offices with the contractor owner, superintendent, and job foreman prior to construction and all other city, county, state, and other necessary agencies will be notified of this meeting also.

Contractor shall submit to City a detailed construction progress schedule with major milestones prior to preconstruction meeting.

A preconstruction conference shall be arranged between the Director of Engineering and the Contractor prior to beginning construction. At this meeting the following items shall be addressed.

- a. Work by others. Coordination of work to be performed by subcontractors and other contractors performing work related to this project.
- b. Availability of land. The site and use of adjacent land shall be reviewed.

SECTION 2 – SPECIAL PROVISIONS

- c. Project Engineer. The project engineer will be assigned by the Director of Engineering. The Contractor shall designate a construction foreman that will be responsible for communication with the project engineer.
- d. Change orders. Procedures for implementing change orders shall be reviewed.
- e. Tests and inspection. As described within these documents the Contractor shall perform all necessary tests and inspections. Any documented results shall be submitted to the project engineer. At all times the project engineer shall be allowed to inspect the work being performed.
- f. Safety and protection. The Contractor shall be responsible for all safety and necessary protection of all persons in attendance of the project site. The project engineer and other observers shall adhere to all safety precautions deemed necessary by the Contractor.
- g. Final inspection and payment. Final inspection shall be performed by the Director of Engineering and their representatives. When all aspects of this project, as described within these documents have been met, the Contractor may submit for final payment.
- h. Site security. The contractor shall erect a construction barrier around the project site. The barrier shall consist of a temporary fence with appropriate warning signs.
- i. Shop drawings, submittals. The required list of submittals shall be reviewed.
 - Concrete mix design
 - Traffic Control Plan
 - Water and Sewer material
- j. Pipe Cleaning Video: When the project involves water main installation, at the end of the pre-construction conference, an AWWA instructional video on the proper cleaning and installation of water mains shall be watched by the Contractor (Owner); the Contractor's Project Foreman; Project Inspector (HU); Water Department Superintendent (HU); and one representative of HU Engineering. At the end of the video, the participants shall review the requirements for pipe installation and cleaning as noted in the specifications and on the drawings.

2.022 Customer Relations. Contractor shall exert all reasonable efforts to maintain good will for the benefit of City of Hastings with the landowners tenants, and lessees along the right-of-way and with the general public. The Contractor will not be allowed to start construction until he has adequate manpower and material to allow the job to progress smoothly and be complete in a reasonable amount of time. City of Hastings will have the authority to remove workers from the job site who exhibit horseplay and foul language to the public.

2.023 Operations of the Contractor. The Contractor shall confine operations exclusively to easements and public right-of-way. If the Contractor desires to operate equipment or store materials on private property that does not have a utility easement, he must obtain permission from the property owner. Prior to release of the payment retention by City of Hastings, the Contractor

SECTION 2 – SPECIAL PROVISIONS

must restore the private property to original condition. If the landowner is not satisfied with the restoration, City of Hastings will continue to hold the appropriate retention.

The quantities for seeding and sodding in the proposal include only easements and right-of-way. Any seeding and sodding required to restore areas where the Contractor has operated on private property without easements will be the responsibility of the Contractor.

SECTION 3

GENERAL DESCRIPTION AND SCOPE OF WORK

3.001 General. The City of Hastings is accepting bids for the installation of new water service, meter house building with internal plumbing, and water distribution piping.

The Bidder shall inform himself of all conditions and factors which would affect the execution of the work. No claims for financial compensation, based on the lack of such prior information (or its effect on the cost of the work), will be permitted by the Owner.

Activity	Schedule
Bid Opening	March 18, 2026
Contract award date	TBD
Pre-Construction Meeting followed by notice to proceed	TBD
Completion date	June 30, 2026
Liquidated Damages	\$100 per day

SECTION 3.1 CONTRACT ITEMS

3.101 Scope of Work. The Contractor shall provide all labor, equipment, materials, and appurtenances necessary to complete the work as described on the drawings.

The intent of these contract documents, specifications, drawings, and appendix are to provide the Contractor a description of the proposed work.

3.102 Schedule. Work can begin once a notice to proceed is issued. Current schedule allows for storm drainage work to be completed in the new right of way at any time so possible coordination may be required.

3.103 Special Testing:

Compaction Testing: Owner to perform compaction testing.

3.104 Special Requirements:

1. American Iron and Steel (AIS): All iron and steel products incorporated in this project shall comply with AIS. This includes obtaining and maintaining adequate certification letters from manufacturers for all relevant iron and steel products. Any waivers or exceptions to the AIS requirement must be obtained in accordance with applicable federal regulations and appropriately documented.

END OF SECTION

**SECTION 4
WATERMAIN AND ACCESSORIES**

SECTION 4-0- SCOPE OF WORK

The work covered by this section of the specifications consists of furnishing all labor, plant, equipment, appliances and materials, and performing all operations necessary to construct and complete water mains and appurtenances in strict accordance with these specifications, the applicable drawings, and subject to the terms and conditions of the contract.

Section 4-1 - Materials

4.101 Water Mains. All water mains shall be constructed of ductile iron meeting the requirements as specified in these contract documents unless otherwise noted on the drawings.

4.101(a) Ductile Iron Pressure Class Pipe. DIP pipe shall comply with the latest revision of ANSI/AWWA C151/A21.51-96 with the exception that the wall thickness shall comply with 350 PSI (2400 kPa) pressure class pipe for sizes 3 thru 24 inch (76 mm thru 600 mm) unless stated otherwise on the plan drawing. Whenever the plans or specifications call for the installation of polyethylene encasement, provide low density polyethylene film in accordance with the latest revision of ANSI/AWWA C105.

4.101(b) Ductile Iron Pipe Shall Be:

- 1) Interior Lining: Cement-mortar lining per ANSI A21.4-16 (AWWA C104), no asphaltic sealer.
- 2) Outside coating: AWWA C151/A21.51 Minimum of 1 mil thickness (0.025 mm) of bituminous coating (paragraph 51.8.1).
- 3) a. Push on joint, ANSI A21.11 (AWWA C111).
b. Alternate pipe joint: Mechanical joint ANSI A211.11 (AWWA C111).
c. As required: Restrained joint pipe for special use (HDD), pipe shall be ANSI A21.51 (AWWA C151) ANSI A21.4 (AWWA C104). See Section 4.103 for pipe restraining.
- 4) In accordance with AWWA C151/A21.51-96 Section 5.1.1.2 provide Affidavit of Compliance.
- 5) Whenever the plans or specifications call for the installation of polyethylene encasement, provide low density polyethylene film in accordance with the latest revision of ANSI/AWWA C105.

4.101(c) Not Used

4.101(d) Not Used

4.102 Compact Ductile Fittings. All fittings for pipe sizes 4" thru 24" (100 mm thru 600 mm) shall be Ductile Iron Pressure Class 350 psi (2400 kPa) and shall conform to ANSI A21.53.94 (AWWA C153) current revised edition of said standards as minimum specifications. All fittings for pipe sizes 30" thru 48" (260 mm thru 1200 mm) shall be Ductile Iron Pressure Class 250 and shall

SECTION 4 - WATER MAIN SPECIFICATIONS

conform to ANSI A21.10.93 (AWWA C110) current revised editions of said standards as minimum specifications.

Ductile Iron Fittings Shall Be:

- 1) Interior Lining: Cement-mortar lined, ANSI A21.4.90 (AWWA C104) without coal tar sealer.
- 2) Mechanical joint, ANSI A21.11.90 (AWWA C111).
- 3) Testing, ANSI A21.10.93 (AWWA C110) or ANSI A21.53.94 (AWWA C153).
- 4) Fitting to be cast marked DI or Ductile with pressure rating and size and type fitting.

4.103 (a) Restrained Joint Pipe. Restrained joint pipe is required in all horizontal directional drilled installations. Restraining method shall be achieved with locking joint such as “TR Flex” by U.S. Pipe or equal for DIP and “Certa-Lok” by Westlake Pipe & Fittings for C900 PVC.

Restraining gaskets such as “fast-grip” gaskets by American pipe or approved equal to restrain push on joint pipe can be used when called out on plans.

When the proposal or drawings require retaining glands, the Contractor shall provide Megalug Series 1100 Mechanical Joint Restraint or equal.

4.103 (b) Restrained Joint Couplings. When noted on the drawings, the Contractor shall erect and install restrained joint coupling(s). The restrained joint coupling shall be a Griffin Bolt-Lok restrained joint, or American MJ coupled restrained joint.

The restrained joint coupling shall provide a positive longitudinal connection between fittings or fittings and restrained joint pipe as applicable. The Contractor shall install applicable thrust blocks as noted on the drawings in addition to the restrained joint coupling.

4.104 Resilient Seated Gate Valves, Cut in Sleeves. All gate valves 4" and larger up to and including thirty inch (30") (260 mm) shall be ductile iron body resilient seated gate valves conforming to AWWA C509, C515, AWWA C111 and ANSI A21.11 specifications and current revisions. All gate valves shall be suitable for mechanical joint connection to ductile iron pipe complete with bolts, glands, and required gaskets. All gate valves shall have a 2" square (50 mm) operating nut and non-rising stem and O-ring type seals. All resilient seated gate valves shall be Mueller Model A-2360-20, M and H Style 3067, Flow Control Series 2500, Clow Model 2638 or 2639 valve or approved equal. When beveled gearing is required, provide valves with a bevel gear assembly to allow the gate to move in a horizontal direction. Cut in sleeves for use with gate valves where required shall be mechanical joint and have stop screw incorporated in body, and shall be Mueller No. H840, H841, or approved equal. For installation requiring a 4", 6", or 8" (100 mm, 150 mm, or 200 mm) cut-in valve, the Contractor shall utilize Mueller C-2360-44 cut-in valves or approved equal. The Contractor shall utilize duck tipped gaskets or plain tipped gaskets as required to complete the field installation. All exposed bonnet and packing bolts shall be ASTM F593 Type 304 Stainless Steel. Gate Valves shall be no more than one year older than the date delivered to the project, or the supplier must show that the valves were stored inside and shall show no signs of wear or damage from storage. All manufacturer tags, bar codes, and SQR tags must remain on the product and must not be removed by the

SECTION 4 - WATER MAIN SPECIFICATIONS

contractor or supplier. City of Hastings Inspector will take pictures and /or remove tags during installation.

4.105 Buried Service Butterfly Valves. Butterfly Valves are not used.

4.106 Valve Boxes. All buried valves shall be provided with Buffalo type cast iron valve boxes or alternate as specified.. Valve boxes shall have a screw type extension sleeve and be designed for the size of valve on which it is to be used and for the depth of cover as required. Covers shall have the word "WATER" cast thereon. Valve boxes shall be Mueller No. H10360, Tyler Series 6850 Type 664-S, 666, 668 as required, or approved equal.

4.106(a) Not Used.

4.107 Solid Ductile Iron Sleeves. Contractor shall furnish couplings for connecting ductile iron to ductile iron pipe or ductile iron to cast iron pipe, or ductile iron to PVC pipe. The inside diameter of the coupling shall be suitable for connecting the ends of either PVC, ductile, or cast iron pipe as required. All solid ductile iron sleeves shall comply with the requirements of 4.102. Provide only long solid sleeves unless otherwise directed by the Engineer. Solid ductile iron sleeves will not be called out on the drawings; however, Contractor shall provide solid sleeves as field conditions warrant and as approved by the Engineer.

4.107(a) Mechanical Joint Connections. When called for on the drawings or proposal, the Contractor shall provide Foster adaptors or equal for water main size 4" through 24". Provide a ductile iron fitting meeting material and pressure requirement of the current revision of AWWA C110 and as defined by Section 4.102 of these specifications.

Provide tee bolt kits for all applications.

4.108 Not Used

4.109 Water Services and Service Line Connections.

- 1) Service Lines 2-inch and Less in Diameter. Plastic water service lines of not more than 2 inches (50 mm) in diameter may be used for residences in lieu of copper service lines, subject to the following:
 - a. Plastic tubing used for water service lines shall meet AWWA C901 Polyethylene pipe, SDR-9 PE3408 ASTM D2737, Pressure Class 200 PSI (1400 kPa) or AWWA C904-06 PEX pipe, SDR-9 ASTM F876 (PEX 1006) Pressure Class 200 PSI (1400 kPa). It shall be O.D. based on sizes 3/4 inch (20 mm) thru 2" (50 mm) conforming to the outside diameter of copper tubing.
 - b. Fittings for plastic water service lines used for plastic water piping shall be of brass pack joints and shall conform to AWWA Standard ASTM B62-Index 115-85-5-5. No plastic fittings or brass flared will be allowed.
 - c. Installation of plastic water service lines shall have a tracer wire installed by Contractor per the standard detail subsidiary to bid. The wire shall be taped to the service prior to backfilling.

SECTION 4 - WATER MAIN SPECIFICATIONS

- d. Grounding of electric services when plastic water services are installed: In the event existing metal water line was the source of grounding is abandoned, supplemental electrodes shall be provided. One shall be a rod or pipe electrode as specified in NEC 250.53, and the others shall be as mandated in NEC 250.52.
 - e. For replacement services the interior metal piping system shall remain bonded to the service equipment. If there is not a ground rod already in use, an 8 foot rod (2.4 m) shall be driven and connected to the service equipment. The grounding electrode system shall comply with NEC 250.50.
 - f. The city electrical inspector shall approve the installation after being satisfied that there is appropriate grounding.
 - g. The owner shall pay an additional fee in accordance with the prevailing council fee resolution, for having the plumbing and electrical inspectors make the foregoing inspections.
- 2) Service Lines 4-inch diameter and larger
- a. Shall meet the City of Hastings watermain specifications.
 - b. Require an inline tee orientated up installed immediately downstream of the service valve.
 - c. The City of Hastings Water Utility will inspect installation as deemed necessary, operate service valve, observe the required pressure test, assist with cleaning, and conduct bacteriological sampling.
 - c.1. Fire mains: Pressure test requirements and test observation completed by the fire marshal.
 - d. Installation of plastic water service lines shall have a tracer wire installed by Contractor per the standard detail subsidiary to bid. The wire shall be taped to the service prior to backfilling.
 - e. Grounding of electric services shall be in accordance to specification 4.109 Water Services; paragraphs 1(d) and 1(e) of this document.
- 3) Service Taps. All taps shall be completed by the City of Hastings through tapping fees, with exception being contracts with the City. Contracts with the City for watermain work require all material to be supplied by the contractor.

All taps require a service saddle to be installed unless otherwise noted on the plans. All 1" taps require a contractor provided service saddle properly fastened to the main. For taps >1", the city will supply and install the saddle as part of the tap fee with all excavation and trench safety to be completed by the contractor.

- 4) Service Saddles.
- a. DIP: The service saddle must be constructed of high strength ductile iron per ASTM A536 with fusion-bonded epoxy coating having a double wide band and 1/2" UNC threaded studs constructed of type 304 stainless steel. Provide saddles with EPDM

SECTION 4 - WATER MAIN SPECIFICATIONS

rubber gaskets per ASTM D2000. Saddles must be ANSI/NSF Standard 61 for use in drinking water applications and must conform to AWWA C800.

- b. PVC C900: The service saddle must be constructed of brass conforming to AWWA C800 and NSF 61 certified for use in drinking water applications. All required fasteners shall be silicon bronze and threads conforming to AWWA/CC taper. Saddles shall have a minimum working pressure of 150 psi. Acceptable products are Ford S90 or approved equal.
- c. HDPE: Require an Electrofusion fitting, Transition Saddle (Corp Saddle). The Contractor shall provide the transition saddle and shall properly fasten the saddle to the main. Electrofusion Transition Saddle shall have a manufacturing standard of ASTM F1055. The Contractor shall provide Electrofusion Transition Saddle equal to Georg Fischer Central Plastics Company with brass 360 alloy outlet materials, and stainless 304 compression ring, and CC Threads or approved equal.

- 5) Corporation Stops. Corporation Stops are included in the tap fee assessed with the City. For contracts held with the City of Hastings where tap fees are not assessed, the contractor is responsible for supplying and installing the corporation stops.

The corporation stop shall meet AWWA C800 standard and NSF61 certification. All corporation stops to be key style with AWWA/CC taper thread by flare fitting with the 1” and smaller to include a copper swivel type elbow with AWWA/CC female thread by CTS pack joint. All 1.5” and larger to include a straight copper coupling with AWWA/CC female thread by CTS pack joint (Saddle and valve/corporation stop supplied and installed by the City and assed tap fee). Acceptable manufacturer is FORD METER BOX or approved equal.

- 6) Curb Stop and Box. This item shall consist of one (1) curb stop and one (1) curb box. Curb stops shall be Mueller No. H-15155 or Ford B44 Series, unless otherwise specified, and shall be of the same nominal size as the service line to which they are connected. Curb stops shall be of heavy cast bronze construction and shall be Minneapolis pattern type. Curb boxes shall be extension type, cast iron, adjustable for length, and have Minneapolis pattern base. Lids shall have the word "WATER" cast in them and shall have a provision for being securely held in place.

4.110 Thrust Block. All thrust blocks shall be installed in accordance with the drawings. The class of concrete to be used for thrust blocks around fittings shall be Nebraska Department of Roads Class "47B" or Type "ABX". All thrust blocks shall be cast in place and shall be considered subsidiary to the unit price of water main in the contract. All concrete shall have minimum 28 day strength of 3000 PSI.

THRUST BLOCK DIMENSION				
Pipe Size Inch	A Feet	B Feet	C Feet	D Inch
4 (100 mm)	1 (0.3 M)	1 (0.3 M)	1 (0.3 M)	3 (75 mm)
6 (150 mm)	1.5 (0.45 M)	1.5 (0.45 M)	1 (0.3 M)	6 (150 mm)

SECTION 4 - WATER MAIN SPECIFICATIONS

8 (200 mm)	2 (0.6 M)	2 (0.6 M)	1 (0.3 M)	6 (150 mm)
10 (250 mm)	2.5 (0.75 M)	2.5 (0.75 M)	2 (0.6 M)	9 (225 mm)
12 (300 mm)	3 (0.9 M)	3 (0.9 M)	2 (0.6 M)	9 (225 mm)
14 (350 mm)	3 (0.9 M)	3 (0.9 M)	2.5 (0.75 M)	12 (300 mm)
16 (400 mm)	4. (1.2 M)	3 (0.9 M)	2.5 (0.75 M)	12 (300 mm)
18 (450 mm)	4 (1.2 M)	4 (1.2 M)	2.5 (0.75 M)	12 (300 mm)
20 (500 mm)	4 (1.2 M)	4 (1.2 M)	3 (0.9 M)	16 (400 mm)
24 (600 mm)	4.5 (1.4 M)	4.5 (1.4 M)	3 (0.9 M)	16 (400 mm)
30 (750 mm)	4.5 (1.4 M)	5. (1.5 M)	3.5 (1.0 M)	18 (450 mm)
36 (900 mm)	5 (1.5 M)	5 (1.5 M)	3.5 (1.0 M)	18 (450 mm)
42 (1050 mm)	5.5 (1.7 M)	5.5 (1.7 M)	4 (1.2 M)	24 (600 mm)
48 (1200 mm)	6 (1.8 M)	6 (1.8 M)	4 (1.2 M)	24 (600 mm)

4.111 Machine Tap. City of Hastings will furnish and install all machine taps. Contractor shall provide all excavation and backfill. Minimum excavation at each tapping point will be 4 ft. wide (1.2 M) and 6 ft. (1.8 M) long and shall be sufficiently below the main at point of tap in the installation of bolted sleeve. City of Hastings Water Department Personnel shall make determination in field as to tap location and give specific requirements. In the event that the uncovered water main is at a joint, etc., excavation will be relocated as directed by Water Department Personnel.

4.112 Not Used.

4.113 Not Used.

4.114 Not Used.

4.115 Not Used.

4.116 Submittals. The Contractor shall provide to the Engineer the following submittals, shop drawings, certifications and other related documents for review and approval:

- a. Provide catalog cuts showing weights, dimensions, and sizes of all pipe materials, fittings, glands, bolts, adapters, etc. to be utilized on this project.
- b. Provide catalog cuts of all fire hydrants, gate valves, butterfly valves, fittings, manholes, valve boxes, grounding mechanisms, tracer wire, corporation valves, curb stop, curb stop boxes to be utilized on this project.

SECTION 4 - WATER MAIN SPECIFICATIONS

- c. Provide catalog cuts showing weight, dimensions and sizes of all casings, casing chocks, and casing ends seals to be utilized on this project.
- d. See specification 1.606 for additional details.

4.117 Tracer Wire: Tracer Wire: 12- or 14-gauge AWG solid copper wire with 30 mil, high density, HMWPE coating conforming to ASTM B-3, B170, and D1248. Acceptable products are PRO-TRACE COPPER PE30 or approved equal.

4.118 Tracer Station: Tracer wire access point shall be secure, easy to locate, anti-corrosion, color coded per APWA, and contain a direct connection point. Acceptable products are Copperhead Industries SnakePit or approved equal.

4.119 Bury Tape: Polyethylene material, 6 inches wide with 4.0-mil thickness, color coded per APWA and overcoated graphics. Must be rated for outdoor bury.

4.120 Pipe Cleaning Pigs: Properly sized medium density bare foam and medium density foam with durable polyurethane elastomer coating applied in a criss-cross pattern and embedded with plastic bristle brush straps. Manufactured by Pigs Unlimited or approved equal.

SECTION 4-2 - CONSTRUCTION METHODS

4.201 Excavation. The Contractor shall perform all excavation of whatever substances are encountered to the depth shown on the drawings, or to provide a minimum cover of five (5) feet (1.5 M) over the top of the pipe. The Engineer shall have the right to limit the amount of trench that may be opened in advance of the line of work, along with the duration in which the excavation is open. All excavated materials not required for backfill shall be removed from the project by the Contractor. Banks of trenches shall be kept as nearly vertical as practicable and, where required, shall be properly sheeted and braced. Trenches shall be of sufficient width to provide working space for proper laying and embedment. Excavation around existing utilities and structures shall be limited to minimum invasive practices such as utilization of properly sized trench safety equipment in-leu of benching.

The bottom of the trenches shall be accurately graded to provide uniform bearing and support for each section of pipe on undisturbed soil at every point along its entire length, except for portions of the pipe sections where it is necessary to excavate for bell holes.

Whenever wet or unstable soil that is incapable of properly supporting the pipe, as determined by the Engineer, is encountered in the trench bottom, such soil shall be removed to the depth and length determined by the Engineer, and the trench backfilled to grade with in-situ soils or other suitable material as deemed appropriate by the engineer.

All grading in the vicinity of trench excavation shall be controlled to prevent surface water from flowing into the trench. Any water accumulating in the trench shall be removed by pumping or other approved method. Material excavated from the trenches shall be stacked in an orderly manner a sufficient distance back from edge of trenches to avoid overloading and preventing slides

SECTION 4 - WATER MAIN SPECIFICATIONS

or cave-ins. Material unsuitable for backfilling shall be wasted by the Contractor as directed by the Engineer. Any unauthorized excavation below grade shall be backfilled at the Contractor's expense with good, well-tamped material.

A minimum of one foot (1') (300 mm) of topsoil (unless otherwise noted on the plans) shall be removed in any and all areas covered by vegetation. This topsoil shall be stockpiled separately from the material removed from the remainder of the trench. After the pipe is installed and the trench backfilled to an elevation one foot (1') (300 mm), (unless otherwise noted on the plans) below grade, the topsoil shall be replaced and compacted as previously described.

Excavation will not be classified. Whatever material is encountered shall be excavated to the proper grades and if, in any locations, such material is not sufficient to provide a uniform, even bed for the pipe, the trench shall be excavated at least six inches (6") (150 mm) deeper than the grade at the bottom of the pipe and the space thus excavated shall be refilled with earth or sand and thoroughly compacted.

4.202 Horizontal Directional Drill (HDD).

Directional drilling to be completed by an experienced Contractor. The contractor shall submit a work plan prior to beginning work which outlines the procedure and schedule to be used while construction is in progress. The work plan must include specific equipment to be used, list of supervisory, technical, and general personnel to be utilized during the project. Any permits required but not limited to erosion & sediment control plan, traffic control plan and trench shoring plan to be submitted.

HDD shall utilize a guidance system along with drilling fluid (mud) system. The drilling fluid system shall include a self-contained drilling fluid mixing system adequately sized. The drilling fluids to be mixed thoroughly and be absent of any clumps or clods. No hazardous additives may be used. Used drilling fluid and spilled fluid to be contained and disposed of properly.

The drill path is to be accurately surveyed with entry and exit stakes placed in appropriate locations. The minimum cover required over water main piping is five (5) feet. Additional bury depth may be required as indicated on the plans. In the event the pipe is to be field installed after locating of existing utilities, the contractor must submit a bore plan profile which includes all existing utilities. Excavation around existing utilities and structures shall be limited to minimum invasive practices such as utilization of properly sized trench safety equipment in-leu than benching.

Pilot hole shall be drilled to not exceed the maximum allowed pipe deflection. Upon successful completion of the pilot, the bore will be reamed to a minimum of 25% greater than the outside diameter of the pipe to be installed. The contractor will pull the pipe to be installed back through the bore hole utilizing a swivel to prevent torsional stresses occurring in the pipe. A final bore log must be submitted to the engineer.

4.203 Trench Backfilling. Trench backfill shall conform to following:

- 1) All water mains and services shall be properly bedded with insitu soils unless otherwise directed due to poor soils or soil conditions. The Engineer shall instruct the Contractor in proper operation and fill material if conditions are deemed less than favorable. Insitu soils

SECTION 4 - WATER MAIN SPECIFICATIONS

typically deemed satisfactory are local clay, silt loam, and sandy soils found in the Hastings area.

Ductile Iron Pipe. All ductile iron pipe shall be bedded as shown on bedding detail II of the plans with insitu soils to top of pipe or twelve inches (12") (300 mm) above top of pipe as noted. The bedding process shall be accomplished by mechanical means and by introducing backfill material layers not to exceed six inches (6") (150 mm) depth. Each lift shall be thoroughly compacted before introducing additional backfill material. Hand tamping will be required whenever streets, driveways, or terraces requiring sodding will be placed above the water main installed. The bedding shall be accomplished using a hand tamper for each six inch (6") (150 mm) lift of soil to the top of the pipe. Other mechanical means such as a rolling vibratory sheeps foot can be utilized for the next twelve inches (12") (300 mm) above the top of pipe. **All hand tamping shall be strictly enforced.**

- 3) Compaction test may be taken at random locations and different depths as determined by inspector. Average of two compaction tests will be taken at each 50 lineal foot (15 M) of trench and test at an elevation to be determined on job site and dependent on depth of trench. Contractor will be required to make excavation for test.
- 4) Test results for compaction shall meet or exceed following:
 - a. 95% standard proctor density for terraces.
 - b. 98% standard proctor density for driveways, sidewalks, streets.
 - c. Assumption that moisture content (\pm) 3% of optimum failure of test to reach these minimum results will require re-compaction by Contractor.
- 5) No unsuitable material will be allowed in backfilling, i.e., rock, saturated soils, concrete, brick, mortar, vegetation, debris, grasses, etc. Contractor will be required to remove such from job site and replace with adequate amount of approved material. The Contractor shall supply suitable backfill material from an approved borrow site acceptable to the Engineer at the unit price in the proposal.

Any area found unstable because of plastic soils will have to be replaced by the Contractor with suitable material
- 6) Water settling will not be permitted.
- 7) If proper compaction requires additional soil to be brought to the site by the Contractor, all expenses for this additional soil shall be considered subsidiary to the pipe installation.
- 8) Contractor shall return ditch elevations to preexisting elevations as shown on the plans. If it is determined after the construction is complete the Contractor has not done so, he will be required to return the ditch to original elevation at his cost.
- 9) The Contractor shall hand tamp around all fire hydrants, curb stops, and valve boxes with hand tampers or pad tampers ("Jumper Jacks") to insure proper compaction.

In the event settlement of any backfill associated with the project is encountered, the Engineer shall notify the Contractor in writing to repair all defects, including settlement and

SECTION 4 - WATER MAIN SPECIFICATIONS

associated street repair, if it is discovered within the three (3) year maintenance period. No extra monies will be paid for repairs caused by settlement of the backfill.

4.204 Trench Wall Support. All trenches shall be braced or sheeted as to local soil conditions dictate and in full compliance with OSHA, as well as local, State of Nebraska, and other Federal requirements. There shall be sufficient tamped cover over pipe to protect in removal of shoring material.

4.205 Protection of Existing Utilities. The accuracy of location of existing underground utilities as shown on the plans is not guaranteed. It shall be the duty of the Contractor to locate these utilities in advance of excavation, and to protect same from damage after uncovering. House service lines are shown on the plans. The Contractor shall contact the owners of the utilities for assistance in locating these service lines. Any expense incurred by reason of damaged or broken lines shall be the responsibility of the Contractor.

The Contractor shall not begin any excavation until he has contacted Diggers Hotline at 811.

4.206 Tunneling. Tunneling, when necessary, shall be done under the supervision of the Engineer. Jacking or boring may be permitted where indicated in the plans. Before proceeding with boring or jacking, the Contractor shall submit to the Engineer for his approval a plan sketch showing the frame, bracing, pit details, etc. Whenever a steel casing is required, joints shall be welded with full strength welds. The Contractor shall maintain proper joint alignment and use full penetration welds.

4.207 Pipe Cutting. Cutting of the pipe shall be kept to a minimum and shall be done in a neat and workmanlike manner without damage to the pipe. Unless otherwise authorized by the Engineer, cutting shall be done by means of an approved type of mechanical cutter. Hydraulic cutters shall be used when practicable.

4.208 Installation of Water Mains.

4.208(a) Installation of DIP Water Mains. The installation of ductile iron water main shall be in accordance with the latest revision of AWWA C600. All DIP (Class 52 and Pressure Class) water main installation shall also be in accordance with the following:

- 1) Pipe and accessories shall be handled in such manner as to insure delivery to the work in a sound, undamaged condition.
- 2) While suspended in a sling and before lowering into the trench, all pipe shall be inspected for defects. Defective, damaged or unsound pipe will be rejected. Deflections from a straight line or grade, as required by vertical or horizontal curves, shall not exceed manufacturer's recommendations and approval by the Engineer.
- 3) Mechanical joints shall be installed under the provisions of the recommendations of the joint manufacturer.
- 4) Fittings at bends or dead ends shall be firmly blocked against the vertical face of the trench to prevent fittings from being blown off the lines when under pressure. Blocking shall conform to the plan for concrete blocking for fittings. Where pipe ends are left for future connections, they shall be valved, plugged or capped as shown on the plans. Where

SECTION 4 - WATER MAIN SPECIFICATIONS

connections are made between new work and existing mains, the connections shall be made by using fittings as required.

- 5) All DIP where noted on the drawings shall have a tracer wire buried beside the invert of the pipe as shown on the drawings. A tracer wire locating station will be supplied to the Contractor by HU. The tracer wire furnished by HU will be a 12 or 14 AWG solid, Protrace HF-CCS PE30 or equal 30 Mil (0.8 mm) HMW-HDPE coated copper wire. The color will be blue. The wire shall be continuous and unspliced from tracer wire locating station to tracer wire locating station. The tracer wire shall be electrically intrinsic with reference to the water distribution system.

All DIP water main or water service lines of 4" (100 mm) diameter or greater shall have warning tape buried 12" (300 mm) to 24" (600 mm) above the top of the pipe. The warning tape will be inscribed with the message "CAUTION BURIED WATER LINE". The warning tape will be a minimum of 3" (75 mm) in width. The warning tape will be a minimum 4 mils (0.1 mm) in thickness. The warning tape will be blue in color and furnished to Contractor by HU. Installation of tracer wire and warning tape will be subsidiary to bid.

- 6) The use of pipe gasket lube shall be limited to Blue Lube manufactured by Whitlam Plumb-Pro or equal. The use of yellow gasket grease is not permitted or allowed to be stored on site. Pipe gasket lube shall be NSF Standard 14 and 61 certified for potable use. Care shall be taken to limit the amount of pipe gasket lube applied as this will aid in cleanup of the water main and assemblies.

4.208(b) Not Used.

4.208(c) Not Used.

4.208 (d) Installation of Service Lines.

All service lines require a tracer wire to be installed with the pipe and extended up the stop-box for future access. The contractor is responsible for confirming the proper stop box and position of the service valve before re-connecting. Notify customers of any shutdowns and reconnections.

City of Hastings Contracts: All water service line work inside the right-of-way is deemed utility work and can be completed by a watermain contractor when there is relative main work being completed. Any work to be done on the customer side of the curb stop, except for connecting the service line to the curb stop, shall be done by a licensed plumber.

A licensed plumber shall secure and obtain a plumbing permit for any water service work on private property. All plumbing permits shall be obtained before any work begins.

Privately Constructed Services: A licensed plumber is required to acquire a permit for all services. Through a tapping fee, the City of Hastings will make all taps.

4.209 Pipe Plug. The Contractor shall utilize a water tight mechanical plug or cap of appropriate size to secure the open end of the pipe from debris entering into the pipe. This shall be strictly enforced at the end of each day, during any breaks lasting more than 30 minutes or

SECTION 4 - WATER MAIN SPECIFICATIONS

unscheduled stoppage which the pipe may be left unattended for more than 30 minutes. Buckets, duct tape and other methods will not be allowed.

4.210 Service Interruptions. When it becomes necessary, for the purpose of making connections or for any other reason, to shut off or turn on water in any existing mains, it is the sole responsibility of the Contractor to notify the City Water Department, through the Resident Engineer, as to when and for how long service will be interrupted, and also to notify all water users well in advance to that they might prepare themselves for the period during which service might be interrupted. Water system valves shall not be opened or closed by anyone other than City Water Department personnel.

4.211 Fire Hydrants and Valve Boxes. All fire hydrants, valves, and valves boxes shall be installed in the lines as shown on the drawing and as directed by the Engineer. All apparatuses shall be set plum. Valve boxes shall be centered directly over the valves. Earth fill shall be carefully hand tamped around all valve boxes and fire hydrants. Valves boxes shall have the interiors cleaned of all foreign matter before installation.

All valve boxes shall be installed to permit without restriction valve wrenches. All fire hydrants shall be installed in accordance with the latest revision of AWWA Manual M17, "Installation, Field Testing and Maintenance of Fire Hydrants", and no more than 1/4" per two (2) vertical feet out of plumb in any direction. The engineer shall measure the plumbness of all fire hydrants installed. Any fire hydrant not installed correctly and plumbed shall be straightened and any additional extensions of the barrel to raise it to grade shall be provided without additional reimbursement. Review of the plumbness test by the Engineer shall be requested by the Contractor prior to beginning of the project. If a review is not requested, the Engineer may assume the Contractor fully understands the requirements for proper hydrant installation.

4.212 Cleaning, Disinfection, Flushing and Pressure Testing of Water Mains

A. Cleaning

Procedures for the disinfection of the water mains and service lines 4" and larger shall be in accordance with the latest revision of AWWA C651. Specifically each segment of completed water main to be disinfected shall not exceed a length greater than 1,000 LF unless otherwise approved by the Engineer.

All costs associated with disinfection, flushing and pressure testing of the water mains and appurtenances shall be considered subsidiary to the main installation.

To aid in the cleaning and disinfection of the water main the contractor shall comply with the following:

1. All water main materials shall be shipped in plastic wrap or provided removal plugs to limit contamination during shipping. Water main pipe shall be shipped with a tarp or cover to protect the pipe end (windward end) during transport.

SECTION 4 - WATER MAIN SPECIFICATIONS

2. Onsite storage of water main materials shall be placed on skids or blocks to limit contamination while in storage. Provide minimum of 4 inches elevation above the ground line and not located in areas that may become flooded.
3. Tarps or plastic wrap shall be provided to secure the open end of the pipe and water materials from contamination during site storage. Contractor shall limit site storage to amounts that can be installed in a timely manner to limit contamination.
4. Each section of pipe, all fittings and other water main assemblies shall be thoroughly inspected for presence of dirt, oil film(s), and debris prior to installation. Contractor shall remove and clean all visible contamination.
5. During installation the open end of the water main or assembly shall be fitted with a plug to limit contamination. This shall be used at all times. For periods where construction will be delayed for more than 1 hour a tight fitting plug shall be installed that will prevent water intrusion at a pressure of at least 10 feet of hydraulic head.
6. A suggested process for cleaning the water main pipe prior to installation is to power wash the inside of the pipe from each end of the pipe then swab each pipe with a soft foam or soft sponge pig soaked with chlorinated water, swab once from each end using a bull float pole to push the pig through. Then power wash the inside of each pipe one more time. Bag each end of the pipe with a heavy plastic garbage bag and seal with duct tape.
7. Use of granular chlorine or chlorine tabs will not be permitted.
8. A pipe cleaning pig launching and receiving assembly shall be supplied and installed. For City contracts, pipe cleaning pigs will be provided for two rounds of cleaning, additional pigs will be the contractors expense along with City of Hastings labor and equipment costs. For private contracted projects, the costs of pigs is responsibility of the owner, along with City of Hastings labor and equipment costs.
9. A written plan for providing cleaning, disinfection and sampling shall be provided to the engineer for approval before main installation begins. A walk thru of the project prior to main installation shall be conducted with the contractor foreman to review disinfection procedures.

Flush Water Disposal

The contractor shall provide all piping, hoses, ditches and other conveyance devices to properly dispose of the water from the water mains. The following procedures shall be used:

1. Flush water containing chlorine in excess of 1 mg/l shall be directed to the sanitary sewer at rates that do not exceed the capacity of the receiving sanitary sewer. In the event a sanitary sewer is not available to the contractor, City of Hastings Sewer Department shall provide assistance in removing the chlorine. Plan and procedures for de-chlorination shall be approved by the engineer prior to commencing work.
2. Waters containing 1 mg/l or less of free residual chlorine to be flushed from the main shall be directed to appropriate storm sewers, ditches or other drainage ways. Disposal of

SECTION 4 - WATER MAIN SPECIFICATIONS

flushed water shall be the responsibility of the contractor. Erosion caused by flushing activities shall be repaired by the contractor. Repair of right of ways and private property shall be completed to the satisfaction of the property owner or controlling authority.

B. Hydrostatic Pressure Testing: Hydrostatic testing shall be in accordance with the latest revision of AWWA C600 Section 4 or AWWA C605 Section 7 as deemed appropriate. Hydrostatic testing shall be performed at a pressure of 140 psi (965 kPa) minimum to 150 psi (1035 kPa) maximum, with an maximum drop in pressure of 2 psi (14 kPa) over a two hour period. All defective materials or improperly installed materials shall be repaired or replaced as deemed appropriate by the engineer. The hydrostatic pressure test shall be repeated after all repairs are completed and until satisfactory results are obtained.

C. Water Main Disinfection and Flushing

Water main disinfection and flushing shall be completed in a timely manner. As noted above a written plan shall be prepared and provided to the engineer for approval. The plan shall limit the amount of time water is allowed to be placed in the main prior to disinfection procedures are applied. The following terms and conditions shall be used with respect to disinfection and flushing of water mains:

Step 1. Pre-flushing (By HU Forces): Once the water main has been installed and all appropriate control valves placed into service, the water main shall then be flushed with potable water. This shall be done at a minimum velocity of 5 fps or maximum achievable with normal system water pressure. Pre-flushing of the water main shall be conducted for a sufficient period of time until the water is clear and then an additional five (5) pipe volumes of water shall be discharged. See above for flush water disposal requirements. City of Hastings forces shall be responsible for the operation of all Hastings water valves.

Step 2. Hydrostatic Pressure Testing (By Contractor): Immediately after pre-flushing of the main (within 1 hour) the water mains shall be hydrostatically tested.

Step 3. Aggressive Main Cleaning (Pigging) (By Contractor): Following successful hydrostatic testing (within 1 hour), water mains shall be aggressively pigged. Every effort shall be made to aggressively clean all sections of the water main. Appropriate sized pigs will be pushed through the pipe being cleaned using water system pressure. A set of pigs consist of the following:

Pipe Cleaning Pig Set	
Pig Description	Qty. of Pigs per 1000 ft.
Medium Density Foam Vinyl Coated w/ Plastic Bristle	2
Medium Density Bar Foam with Cone End	2

Run pigs one at a time, starting with the vinyl coated scrubbing pig and repeat until the flush water is clean before repeating the process with the bare foam pig. See above for flush water

SECTION 4 - WATER MAIN SPECIFICATIONS

disposal requirements. City of Hastings forces shall be responsible for the operation of all Hastings water valves.

Rev 2- 2020

Step 4. Initial Disinfection (By Contractor): Immediately after the water main has been aggressively cleaned (within 1 hour), the water main shall be disinfected with chlorine. Sufficient amounts of chlorine shall be used to provide a minimum of 25 mg/l to a maximum of 100 mg/l of free chlorine residual for a minimum contact time of 24 hours. Chlorine shall be added to each section of main using a continuous-feed method. The contractor shall provide, install, and operate all chlorination equipment. Chlorine chemical will be supplied by the owner and placement is the responsibility of the contractor. No additional compensation is provided. City of Hastings forces shall be responsible for the operation of all Hastings water valves.

Step 5. Flushing (By HU Forces): Once the water main has been disinfected the water main shall be flushed. Flushing of the water main shall be conducted for a sufficient period of time to remove all traces of chlorine. A field chlorine test shall be conducted to confirm all chlorine has been removed. See above for flush water disposal requirements and specifically for waters containing chlorine. Once the chlorine is removed flush an additional five (5) pipe volumes. City of Hastings forces shall be responsible for the operation of all Hastings water valves.

Step 6. Bacteriological Sampling (By HU Forces): Once the water main has been flushed of disinfectant samples for coliforms and heterotrophic bacteria (a.k.a. HPC or plate count) shall be collected. The water shall be tested for chlorine residual to insure that all chlorine has been removed. The water samples shall be collected from a sanitary access tap properly sized and approved of by the City. The water main shall not be aggressively flushed during the sample collection. The water main is deemed to be clean once two sets of samples are collected 24 hours apart and show no evidence of coliforms (zero coliforms) or heterotrophic bacteria (a.k.a. HPC or plate count) greater than 500 colony forming units per ml (500 cfu/ml).

All samples will be collected by HU forces and delivered to a third-party testing lab.

During each sampling event, coliform and heterotrophic bacteria samples shall be collected at a point where system water enters the project. These samples are collected to insure the water used for cleaning of the mains is potable.

Step 7. Re-cleaning of the water main (By Contractor): If the water main after testing and flushing as noted above has not been successfully cleaned, then it shall be re-cleaned beginning with Step 3 as noted above. All water used after initial Step 6 as noted above shall be metered using estimated flow rates as determined by City of Hastings. This water shall be purchased by the contractor at current residential (Urban) water rates. Expense of all retesting of the water main for coliforms and heterotrophic bacteria (a.k.a. HPC or plate count) shall be the responsibility of the contractor.

Step 8. Surfactant Cleaning (by Contractor): If deemed necessary by the contractor the water main may be cleaned using a National Sanitation Foundation (NSF) approved surfactant equal to a Johnson Screens NW-400. Application rate of the surfactant shall be as per manufactures recommendation. NW-400 shall be injected at a rate of 1 gallon per 1500 to 2000 gallons of water. Additionally the main shall be provided chlorine at a minimum rate of 25 mg/l and a maximum of 100 mg/l of free available chlorine. The surfactant and chlorine shall be allowed to be in contact

SECTION 4 - WATER MAIN SPECIFICATIONS

with the pipe interior for a minimum of 24 hours and a maximum of 96 hours. Flushing of the surfactant and chlorine shall be deemed complete when there is not chlorine residual present.

4.213 Separation from Sanitary Sewer Mains. There shall be a minimum of eighteen (18) inches (450 mm) clearance between water mains and sanitary sewer mains crossing at approximately ninety degrees (90°). There shall be a minimum of 10' horizontal clearance between water mains and sanitary sewer, manholes and storm sewers measured from outside of pipe to outside of pipe.

4.214 Encasement Pipe. The encasement pipe for railroad and street crossings shall be installed by tunneling. Steel casing sections shall be connected by seam welding. The seam shall be a butt joint. Field welding shall conform to AWWA standard C206.

Casing chocks shall be provided as indicated on the drawings and installed per manufacturer recommendations. The casing chocks shall be securely fastened to the carrier pipe. The casing chocks shall be placed approximately 7'-0" (2.1 M) on center with a casing chock placed 3'-0" (0.9 M) from each end of each section of pipe. On a standard 20'- 0" (6.0 M) length of pipe, three casing chocks shall be installed.

Both ends of the encasement pipe shall be closed with a standard pull-on S-shaped seal as manufactured by Pipeline Seal and Insulator Inc., Model S, Advance Model AC End Seal, or approved equal.

After installation of the smooth steel pipe, City of Hastings shall install two 48 pound (21.8 Kg) sacrificial anodes or as determined by the Engineer shall be attached and buried at each end of the encasement. The anodes shall be attached to the outside of the encasement, one on each side.

SECTION 4-3 - METHOD OF MEASUREMENT AND BASIS OF PAYMENT

4.301 Water Main. Water main shall be measured for payment by measuring the length down the center line of construction of all pipelines installed, with no deduction for fittings or valves. Payment shall be made at the contract unit price per lineal foot for various sizes, including fittings, excavation and backfill, complete in place. The cost of providing and installing location tape shall be considered subsidiary to the water main.

4.302 Valves and Boxes. Valves and valve boxes shall be paid for at the contract unit price, complete in place.

4.303 Hydrants. Fire hydrants shall be paid for at the contract unit price, complete in place.

4.304 Manholes. Manholes shall be paid for at the contract unit price bid per manhole, for a depth of five feet (5') (1.5 M), which payment shall include footings, ring and cover. Additional payment shall be made for manholes more than five feet (5') (1.5 M) in depth, measure from top of footings to top of cover, at the contract price for each vertical foot or fraction thereof in excess of five feet (5') (1.5 M).

4.305 Fittings. Fittings such as tees, bends, solid sleeves, MJ to MJ adapters, and reducers including all glands and bolts shall be paid for at the contract unit price, complete in place. If in the event additional fittings are required to be installed, then additional fittings shall be paid for at the unit price per pound of the base weight of the fitting.

SECTION 4 - WATER MAIN SPECIFICATIONS

All ductile iron fitting weights shall be computed using AWWA C153.D.I. Compact Fittings whenever appropriate. In the event a compact fitting weight is not provided by AWWA C153, then the appropriate ductile iron fitting weight as specified in AWWA C110 shall be used. If in the event special items that are called for on the drawings are not referenced in AWWA C110 or C153, then appropriate manufacturer weights shall be utilized. The fitting weights shall consists of the base weight only; all bolts, gaskets and glands shall be considered subsidiary to the pay item.

The Contractor will be reimbursed for actual installed fitting weights using the manufacturers standard weight schedule.

4.306 Boring and Encasement. The construction of encasement pipe shall include boring, excavation, backfill, casing pipe, and cathodic protection. All other items necessary to complete the installation encasement pipe shall be considered subsidiary to the bid item. The amount of encasement installed shall be measured along the center-line of the encasement and shall be paid for at the contract unit price.

4.307 Hydrant Extension. Hydrant extensions as required or as directed by Engineer shall be paid for on a per extension basis; such as 3" (75 mm), 6" (150 mm), 9" (225 mm), etc. Payment shall compensate the Contractor for all labor, fabrication, installation, backfilling, excavating, and all other incidental work as specified or directed by Engineer.

4.308 Valve Box Extension. Valve box extension shall be considered subsidiary to the installation of the valve and valve box.

4.309 Extra Depth Excavation and HDD. When deemed necessary by the Engineer for extra depth greater than 2.0 feet (600 mm) from plan grades, addition compensation shall be provided a per foot depth per linear foot basis. Payment shall include all excavating, backfilling, labor, and other incidental work as specified.

When bury depth is not indicated and rather to be field determined by the contractor, no additional compensations will be made.

No additional compensation will be made when the Contractor varies depth do his operation or failure to control his operation.

4.310 Tracer Wire. The tracer wire and locating station is supplied by HU and the cost of installation by the Contractor is subsidiary to bid.

4.311 Service Connection. The payment for the installation of a service connection for 3/4" to 2" in diameter shall include all excavations, backfilling, re-sodding, re-seeding, service saddles, connections to tracer wire, corporation valves, purchase of materials, fabrications, and all other incidentals for a complete installation. Payment will be made for each class of work and for each size of service required.

4.312 Water Service Lines. The payment for the installation of water service lines for 3/4" to 2" in diameter shall include all excavation, backfilling, re-sodding, re-seeding, service saddles, installation of tracer wire, water service lines, corporation valves, purchase of materials, fabrications, and all other incidentals for a complete installation. Payment will be made for each class of work and for each size of service required.

SECTION 4 - WATER MAIN SPECIFICATIONS

4.313 Curb Stop. The payment for the installation of a curb stop shall include all excavation, backfilling, re-sodding, re-seeding, curb stops, connection to tracer wire, purchase of materials, fabrication, and all other incidentals for a complete installation. Payment will be made for each class of work for each size of curb stop required.

END OF SECTION

Section 5

Meter Piping and Accessories

5.1 General

5.1.1 The layout and support of the pipe shall be completed as shown in the plans. The contractor shall install each fitting and device in a workman like manner and in accordance with manufacturer's recommendations and instructions.

5.2 Material

5.2.1 Gate Valve

1. Standards: Comply with AWWA C515, C505 & C550, ANSI B1 6.1, ANSI B1 6.10, ASTM D429, NSF 61 Certified.
2. Design and Features: Valves shall have a ductile iron body, bonnet, and resilient wedge rubber-encapsulated EPDM. Stainless steel stem non-rising (NRS) and class 125 flange ends with raised face and gasket sealing.
3. Acceptable Products: Watts 405 or approved equal.

5.2.2 Ductile Iron Pipe: Refer to section 4 for pressure class 350 DIP.

1. Ductile Iron Flanges: Shall meet ANSI B16.1 Class 125 bolt patterns and rated pressure of 250 PSI.
2. Ductile Iron Flange Adaptors: Flange adaptors shall meet ANSI B16.1 Class 125 bolt patters and pressure rated to 250 PSI. Acceptable products: EBAA 1000 E-Z Flange Adapter, Ford Uni-Flange Series 400, or approved equal.
3. Ductile Iron Flange Fittings: Refer to Section 4 for ductile iron fittings and this section for flanges.

5.2.3 Dismantling Joint: NSF 61 certified with fusion epoxy coating. AWWA Class D Flanges compatible with class 125 bolts pattern. Acceptable products are Romac DJ400 or equal.

5.2.4 Reduced Pressure Zone Assembly: The Reduced Pressure Zone assembly shall consist of two independent torsion spring check modules, a differential pressure relief valve located between and below the two modules, two drip tight shutoff valves, and required torsion spring check modules and relief valve shall be contained with a sleeve accessible single housing constructed from 304 (Schedule 40) stainless steel pipe with groove end connections. Torsion spring checks shall have replaceable elastomer discs and in operation produce drip tight closure against the reverse flow of liquid caused by backpressure or back siphonage. The assembly shall be a Watts Series 957 or approved equal.

5.2.5 Water Meter: Purchased from the City of Hastings. Meter is a 6" Recordall Compound Series Meter. See appendix for more information.

Section 5: Water Meter Piping and Accessories

5.2.6 Pipe Support: Provide adjustable pipe support as indicated on the drawings. Provide adjustable pipe support with integral saddle as manufactured by Trumbull Industries or approved equal. The contractor shall install the supports securely to the concrete floor using appropriately sized stainless steel expansion anchor bolts. All supports shall be electro-galvanized finished.

END OF SECTION

SECTION 6. Performance Specification –Water Meter Building**1. General Description**

Contractor shall provide a complete, code-compliant structure designed to house a flow water meter assembly. Building shall be approximately 28.5 feet by 11.5 feet in plan with an overall height of 11 feet 8 inches. Provide a gable roof with maximum 5:12 pitch. Provide 18-inch wide eave overhangs with prefinished gutter system at roof edges.

2. Dimensions

- Length: 28.5 ft
- Width: 11.5 ft
- Height: 11 ft-10 in
- Roof Pitch: Max 5:12

3. Structural Requirements

- i. Design structural systems in accordance with ASCE 7 for Nebraska wind, snow, and seismic loads. Provide minimum NO. 2 grade lumber. Provide pressure-treated sill plates at all locations in contact with concrete. Design and install anchor bolts as required for the building structural system.

4. Building Envelope + Insulation (Nebraska Winter Performance)

- i. Walls: Contractor shall install exterior wall insulation consisting of fiberglass batt insulation with a minimum thermal resistance of R-20 for the water meter building. Batt insulation shall be installed within wall cavities, tightly fitted, and free of gaps, voids, or compression. Wall insulation shall be coordinated with the continuous WRB and vapor control layers to maintain uninterrupted thermal, air, and moisture control. Installation shall comply with applicable energy code requirements and manufacturer's recommendations and shall be suitable for high-humidity service conditions.
- ii. Roof: Contractor shall install insulation at the roof/ceiling assembly with a minimum thermal resistance of R-49. Insulation shall consist of fiberglass batt insulation or fiberglass loose-fill (blown-in) insulation and shall be installed to provide continuous thermal coverage, securely supported, and free of gaps, voids, or compression. The roof/ceiling assembly shall include continuous air and vapor control as required, coordinated with the wall air/vapor control layers to maintain continuity of the building thermal envelope. installation shall comply with applicable energy code requirements and manufacturer's recommendations.

5. Foundation & Floor Requirements

- i. Foundation: Contractor shall provide continuous concrete footings and foundation walls as detailed in plans. Continuous footings shall be reinforced with (2) no. 4 bars continuous at top and (2) no. 4 bars continuous at bottom, both faces. Contractor shall provide minimum 3" clear concrete cover to earth and 2" to formed surfaces. lap no. 4 bars 24" minimum, staggered. Contractor shall provide 6" thick concrete slab-on-grade reinforced with no. 4 bars at 12" O.C. each way over 6" compacted granular fill. Provide

Hastings, Nebraska

R-10 rigid insulation at slab perimeter, at 24" depth. All reinforcing steel shall be AST A615, grade 60, securely tied and supported. Construct in accordance with ACI 318 and applicable building code requirements.

- ii. Finished Floor: Contractor shall provide a minimum 6-inch thick reinforced concrete floor slab. Slab shall be reinforced with no. 4 (1/2-inch) grade 60 deformed bars at 12 inches on center each way. Contractor shall provide hard-troweled finish with applied hardener/densifier sealer. Contractor shall provide saw-cut control joints and fill with sealant caulking. Install slab over a minimum 6-inch thick compacted aggregate base course, compacted to meet structural design requirements. Concrete shall meet minimum 3,600 psi compressive strength unless otherwise required.

6. Building Finishes Requirements

Finishes: All colors to be approved by the owner.

- i. Contractor shall install fiberglass-reinforced plastic (FRP) interior wall and ceiling panels, minimum 0.090 in. thick, class a fire rated, moisture and chemical-resistant, installed strictly in accordance with manufacturer's recommendations over continuous, smooth plywood sheathing only. Installation over gypsum board, cement board, insulation, or any other substrate is not permitted. Provide required trims and sealed joints. System shall be suitable for high-humidity water meter building environments.
- ii. Roof shall be either standing seam metal roofing with continuous ridge vent or architectural asphalt shingles with continuous ridge vent. Roofing system shall be installed per manufacturer's requirements, including required underlayment and flashing, and provide a watertight, durable assembly suitable for local weather conditions.
- iii. Contractor shall install metal soffit and fascia system consisting of either prefinished steel or aluminum. Soffit and fascia shall be compatible materials. System shall provide a durable, low-maintenance, weather-resistant roof edge assembly and shall utilize vented soffit panels, as required, to provide minimum necessary ventilation for the roof/ceiling assembly.
- iv. Contractor shall install exterior insulated metal door and frame assembly, fully opaque with no glazing. Door shall be steel or aluminum, weather-tight and suitable for exterior exposure. No structural stoop required, contractor shall drop grade at door while ensuring drainage away from building.
- v. Contractor shall install prefinished aluminum gutter and downspout system. Gutter shall be minimum 5-inch aluminum with corrosion-resistant finish and concealed hangers attached to metal fascia. Provide aluminum downspouts sized to suit roof area and discharge water away from building foundation. Install system watertight.

Hastings, Nebraska

- vi. Contractor shall install exterior wall siding system consisting of vinyl, steel, engineered wood, or fiber cement siding. Install over continuous weather-resistive barrier with required flashing, trim and clearances. Siding shall provide a durable, weather exterior wall assembly.

- vii. Contractor shall install a wall-mounted flood relief flapper gate sized for an 8-inch by 16-inch opening. Gate shall be aluminum or corrosion-resistant metal frame with EPDM or polymer flap, outward-opening under internal water pressure, and suitable for exterior wall installation. Install per manufacturer's recommendations to provide automatic flood relief while preventing exterior backflow.

6. Mechanical Requirements

- i. Electric Unit Heater: Contractor shall provide an electric unit heater to maintain a minimum interior temperature of 40°F within the water meter building. Heater shall be installed on a maximum 30-amp branch circuit. Provide integral or remote thermostat control and a factory-provided high-temperature safety shutoff. Heating system shall provide freeze protection for the water meter, piping risers, valves, and associated appurtenances. Electrical power and controls shall be installed in accordance with the National Electrical Code (NEC) and applicable local requirements.

- ii. Exhaust Fan: Contractor shall provide a mechanical exhaust ventilation system for moisture control and general ventilation at a minimum rate of 300 CFM. Provide a mechanically operable exterior make-up air louver sized to accommodate the required exhaust airflow without excessive pressure drop. The louver shall be equipped with a manual operator crank to allow the opening to be closed during winter conditions and to prevent wind-induced opening when in the closed position. The make-up air opening shall include an integral insect/bird screen at the louver, and a separate heavy-duty exterior vent screen installed at the building exterior. All components exposed to the exterior shall be constructed of corrosion-resistant materials suitable for outdoor exposure.
The exhaust system shall include a backdraft damper and a weatherproof exterior wall or roof termination. Electrical power and controls shall be installed in accordance with the National Electrical Code (NEC) and all applicable local codes and requirements.

7. Execution & Verification

Contractor shall submit shop drawings for the meter building to the Utility Department for review and approval prior to fabrication or installation. Contractor shall be responsible for obtaining all required building permits and coordinating inspections with the Authority Having Jurisdiction (AHJ). The meter building shall be paid for as a single lump-sum item, which shall include all materials, labor, equipment, permits, and compliance with all previously listed specifications and requirements.

APPENDIX

Recordall® Compound Series Meter

Lead-Free Bronze Alloy, Sizes 2, 3, 4 & 6 inch
NSF/ANSI/CAN Standards 61 and 372 Certified

DESCRIPTION

The Recordall® Compound Series meters meet or exceed the most recent revision of AWWA Standard C702 and are available in a lead-free bronze alloy. The Compound Series meters comply with the lead-free provisions of the Safe Drinking Water Act, are certified to NSF/ANSI/CAN Standards 61 and 372 (Trade Designation: LL-NS) and carry the NSF-61 mark on the housing. All components of the lead-free bronze alloy meter (housing, measuring element, seals, and so on) comprise the certified system.

Badger Meter Recordall Compound Series meters combine two metering technologies in one innovative package. A positive displacement chamber measures low flow, while a turbine chamber records high flow.

Offered in four sizes, the Compound Series meter features:

- Patented design that eliminates the need for a trigger valve and maintains crossover accuracy
- Permanently sealed, tamper-resistant register or encoder
- Meters and encoders that are compatible with Badger Meter AMR/AMI systems and other approved reading technologies

Badger Meter ORION® and GALAXY® AMR/AMI meter reading systems are available for all Compound Series meters. Itron® ERT reading systems are also available. All register options are removable from the meter without disrupting water service.

TAMPER-PROOF FEATURES


Unauthorized removal of the register or encoder is inhibited by the use of an optional tamper detection seal wire screw, TORX® tamper-resistant seal screw or the proprietary tamper-resistant keyed seal screw. Each can be installed at the meter site or at the factory.

APPLICATIONS

Use the Recordall Compound meter for measuring potable cold water in commercial and industrial applications where flow is in one direction only. The meter is an ideal choice for facilities that experience rapid and wide fluctuations in water demand, such as hospitals, universities, residential complexes and manufacturing or processing facilities.

OPERATION

At low flow rates, the Compound Series meter diverts water up through a bypass to the disc chamber. Leaving the chamber's outlet port, water flows beyond the turbine element and main valve. As the flow rate increases, a pressure differential is created that opens the main valve. The water then flows straight through the turbine chamber. In addition, a portion still flows through the disc chamber before exiting the meter.

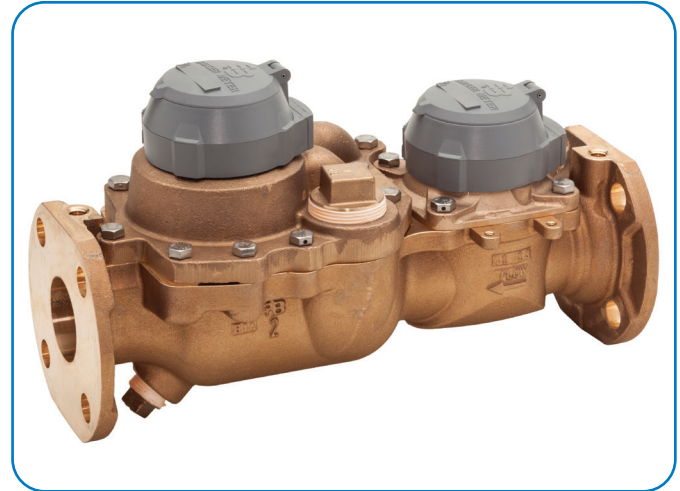

Rotor and disc movements are transmitted by magnetic drive couplings to individual register odometers. The direct magnetic drive provides a positive, reliable and dependable register coupling for straight-reading or remote reading options. The self-lubricating thermoplastic register gearing is designed to minimize friction and provide long life.

OPERATING PERFORMANCE

The Recordall Compound Series meets or exceeds registration accuracy for low, normal operating, maximum continuous operation, and changeover flow rates as specified in AWWA Standard C702.

CONSTRUCTION

The Recordall Compound Series meter's construction complies with ANSI and AWWA C702 standards. It consists of three basic components: meter housing, interchangeable measuring elements, and sealed direct reading registers. The measuring element consists of the disc measuring chamber, turbine head assembly, and high flow valve assembly. To simplify maintenance, the registers and measuring elements can be removed without removing the meter housing from the line.

METER INSTALLATION

The meter is designed for installations where flow is in one direction only. A separate strainer is required to ensure optimum flow conditioning and protection of the measuring element. Companion flanges for installation of meters on various pipe types and sizes are available in cast iron or NL bronze as an option.

REGISTERS / ENCODERS

Standard—Sweep-Hand Registration

The standard register is a straight-reading, permanently sealed magnetic drive register. Dirt, moisture, tampering and lens fogging problems are eliminated. The register has a six-odometer wheel totalization display, 360° test circle with center sweep hand, and flow finder to detect leaks. Register gearing is made of self-lubricating engineered polymer, which minimizes friction and provides long life. The multi-position register simplifies meter installation and reading. The register capacity is 100,000,000 gallons (10,000,000 ft³, 1,000,000 m³).

Optional—Encoders for AMR/AMI Reading Solutions

AMR/AMI solutions are available for all Recordall Compound Series meters. All reading options can be removed from the meter without disrupting water service. Badger Meter encoders provide years of reliable, accurate readings for a variety of applications and are also available pre-wired to Badger Meter approved AMR/AMI solutions. See details at www.badgermeter.com.

SPECIFICATIONS

Compound Series Model	2 in. (50 mm)	3 in. (80 mm)	4 in. (100 mm)	6 in. (150 mm)
Meter Flanges, Class 150	2 in. elliptical or round	3 in. round	4 in. round	6 in. round
	(50 mm)	(80 mm)	(100 mm)	(150 mm)
Typical Operating Range (100% ± 1.5%)	0.5...200 gpm (0.1...45 m ³ /h)	0.5...450 gpm (0.1...102 m ³ /h)	0.75...1000 gpm (0.17...227 m ³ /h)	0.75...2000 gpm (0.17...454.4 m ³ /h)
Low Flow Registration (95% minimum)	0.25 gpm (0.06 m ³ /h)	0.25 gpm (0.06 m ³ /h)	0.375 gpm (0.09 m ³ /h)	0.375 gpm (0.09 m ³ /h)
Maximum Continuous Flow	170 gpm (38.3 m ³ /h)	400 gpm (90.3 m ³ /h)	800 gpm (181.6 m ³ /h)	1500 gpm (340.5 m ³ /h)
Pressure Loss at Maximum Continuous Flow	5.4 psi at 170 gpm	6.0 psi at 400 gpm	11.0 psi at 800 gpm	9.3 psi at 1500 gpm
	(0.38 bar at 38.3 m ³ /h)	(0.41 bar at 90.3 m ³ /h)	(0.75 bar at 181.6 m ³ /h)	(0.64 bar at 340.5 m ³ /h)
Crossover Flow Rate, Typical	12 gpm (2.73 m ³ /h)	12 gpm (2.73 m ³ /h)	20 gpm (4.54 m ³ /h)	30 gpm (6.81 m ³ /h)
Pressure Loss at Crossover	3.5 psi (0.24 bar)	4.0 psi (0.28 bar)	4.0 psi (0.28 bar)	5.0 psi (0.35 bar)
Minimum Crossover Accuracy	97%	97%	97%	95%
Maximum Operating Pressure	150 psi (10 bar)			
Maximum Operating Temperature	105° F (41° C)			
NPT Test Port	1-1/2 in.		2 in.	

Materials

Meter Housing & Cover	Lead-free bronze alloy
Turbo Cast Head	Lead-free bronze alloy
Nose Cone & Straightening Vanes	Thermoplastic
Rotor	Thermoplastic
Rotor Radial Bearings	Lubricated thermoplastic
Rotor Thrust Bearing	Sapphire jewels
Rotor Bearing Pivots	Passivated 316 stainless steel
Calibration Mechanism	Stainless steel & thermoplastic
Measuring Chamber & Disc	Thermoplastic
High Flow Valve	Stainless steel & thermoplastic
Magnets	Ceramic
Register Lens	Glass
Register Housing & Cover	Thermoplastic or bronze
Trim	Stainless steel
Drain Plug (3/4 in.)	Stainless steel or lead-free bronze alloy
Test Plug	Stainless steel or lead-free bronze alloy


PHYSICAL DIMENSIONS

Compound Series Model	2 in. Elliptical (50 mm)	2 in. Round (50 mm)	3 in. (80 mm)	4 in. (100 mm)	6 in. (150 mm)
Meter & Pipe Size	2 in. (50 mm)		3 in. (80 mm)	4 in. (100 mm)	6 in. (150 mm)
Net Weight	45 lb (20 kg)		51 lb (23 kg)	85 lb (38 kg)	152 lb (69 kg)
Shipping Weight	63 lb (29 kg)		79 lb (36 kg)	120 lb (54 kg)	200 lb (90 kg)
Length (A)	15-1/4 in. * (387 mm)		17 in. (432 mm)	20 in. (508 mm)**	24 in. (610 mm)
Width (B)	7-3/8 in. (187 mm)		8-1/2 in. (216 mm)	9-1/8 in. (232 mm)	12-3/8 in. (314 mm)
Height (C)	5-7/8 in. (149 mm)		6-5/8 in. (168 mm)	7-1/4 in. (184 mm)	8-7/8 in. (225 mm)
Flange (D)	5/8 in. (16 mm)		3/4 in. (19 mm)	7/8 in. (22 mm)	15/16 in. (24 mm)
Bolt Circle (E)	4-1/2 in. (114 mm)	4-3/4 in. (121 mm)	6 in. (152 mm)	7-1/2 in. (191 mm)	9-1/2 in. (241 mm)
Centerline (C) to Base (F)	2-3/4 in. (70 mm)		3-5/8 in. (92 mm)	4-1/4 in. (108 mm)	5-3/8 in. (137 mm)
Number of Bolts	2	4	4	8	8


* Adapter available to increase total length to 17 in. (432 mm).

**Adapter available to increase total length to 24 in. (610 mm).

Elliptical Flange (2 in. Only)




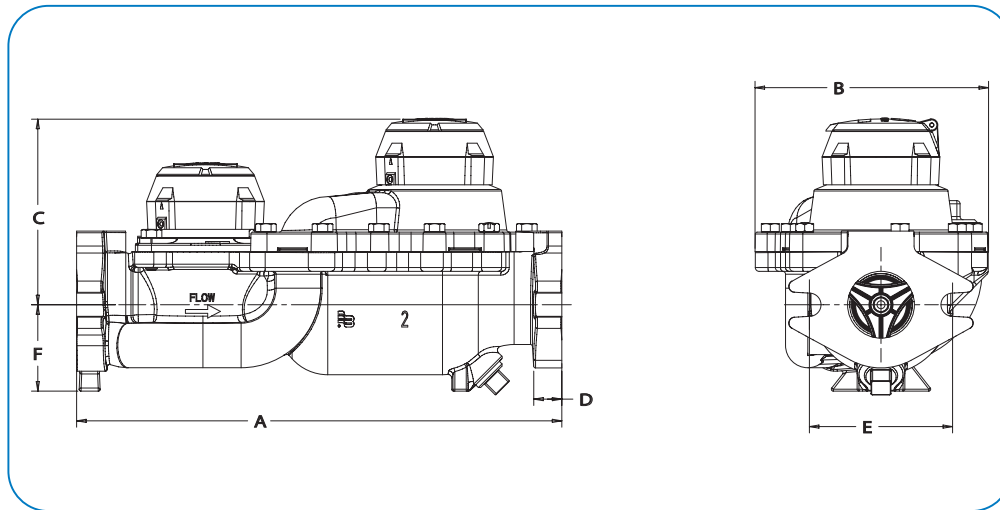


Round Flange

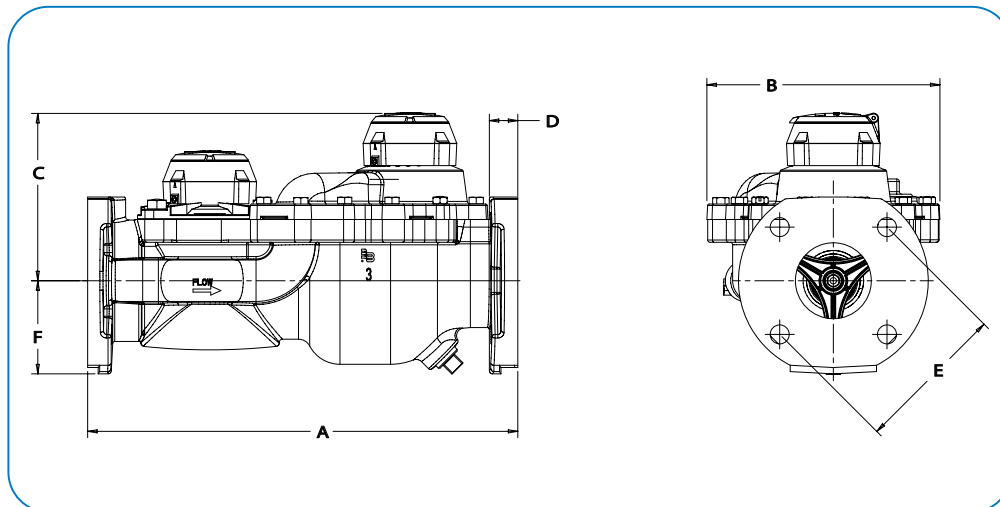


ACCURACY CHARTS

Rate of flow in gallons per minute (gpm). Dashed line on each chart (— — —) represents crossover flow accuracy.

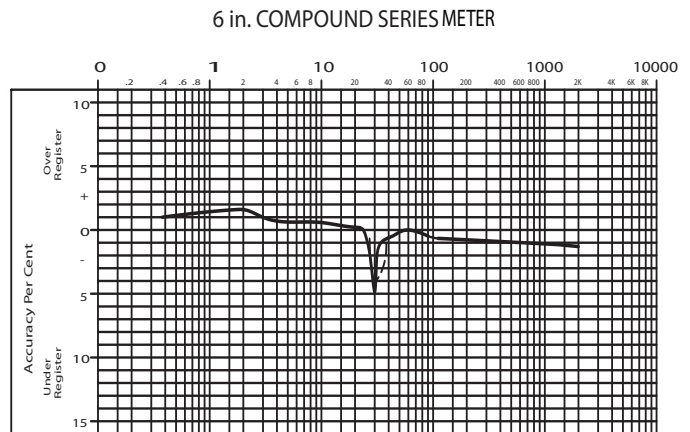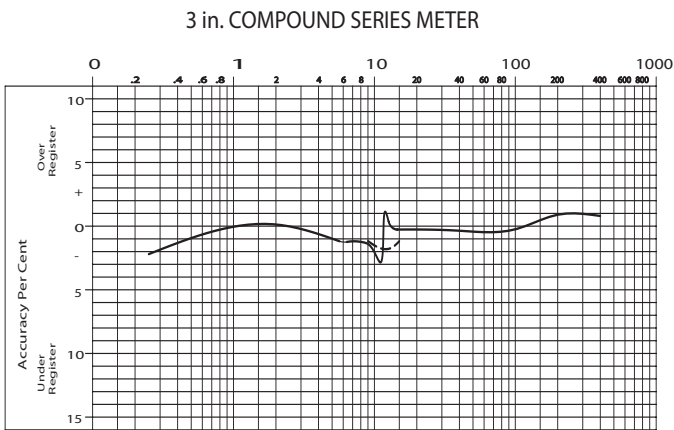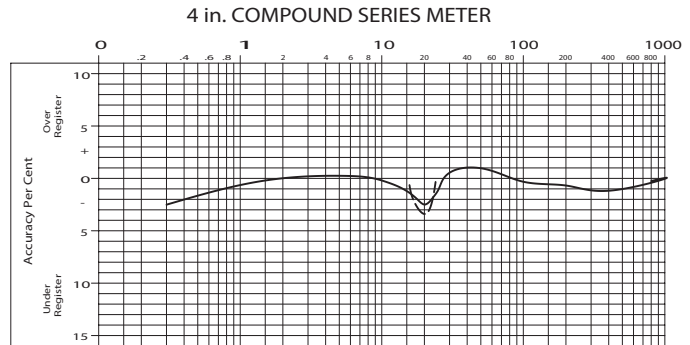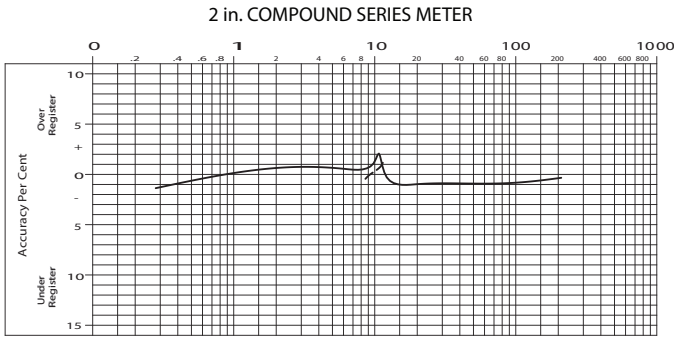

PRESSURE LOSS CHART

Rate of flow in gallons per minute (gpm)

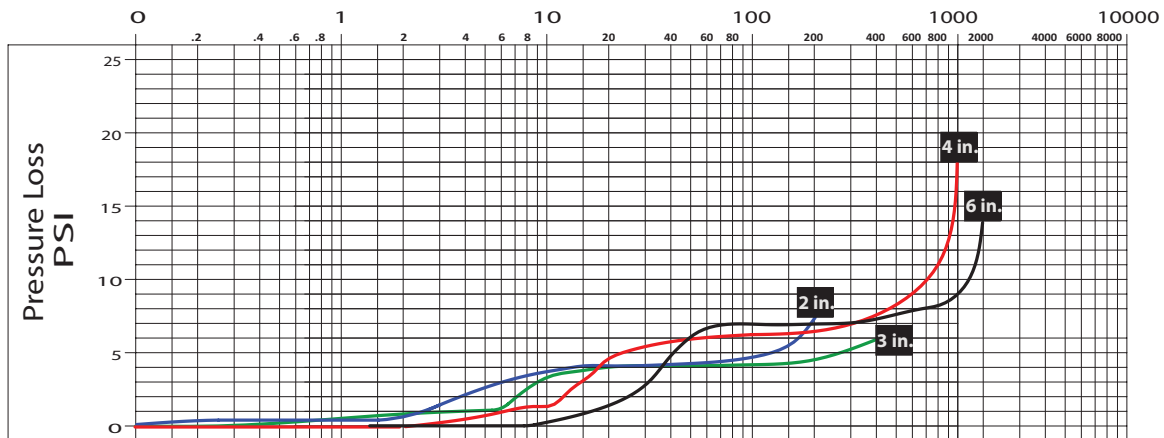

SMART WATER IS BADGER METER

GALAXY, ORION and Recordall are registered trademarks of Badger Meter, Inc. Other trademarks appearing in this document are the property of their respective entities. Due to continuous research, product improvements and enhancements, Badger Meter reserves the right to change product or system specifications without notice, except to the extent an outstanding contractual obligation exists. © 2022 Badger Meter, Inc. All rights reserved.