

At Your Service

Providing Electric, Gas, Water and Sanitary Sewer Services



Hastings Utilities Advisory Board Members

Chairman- Bill Hitesman Vice Chairwoman- Jeanette Dewalt
Secretary- Scott Kvols Susan Meeske, Regg Rutt

March 2026

Backflow Risks and Prevention Methods

Your Responsibilities:

Ultimately, homeowners and occupants at any property are responsible for awareness and management of backflow risks. You are also responsible to respond with the best accuracy TO YOUR KNOWLEDGE regarding the survey when you receive it with your water bill.

Once we have received your survey, we will keep this information in our records for FIVE YEARS.

If you have not received a survey, you do not need to respond.

Complete the Survey (Only choose ONE)

Option A: Scan the QR code at the bottom of this page to complete

Option B:

Go Online to www.cityofhastings.org and search "Backflow survey" and complete the information

Common Backflow Devices

These are some examples of what your device MIGHT look like. Some makes and models vary.

For Wells & Boilers:

These are located at your INTERIOR plumbing



For Outside Faucets:

Look for fittings like those circled here




For Sprinklers:
These are outside.



For Utility Sinks:
If you connect hoses




The cross-connection threat

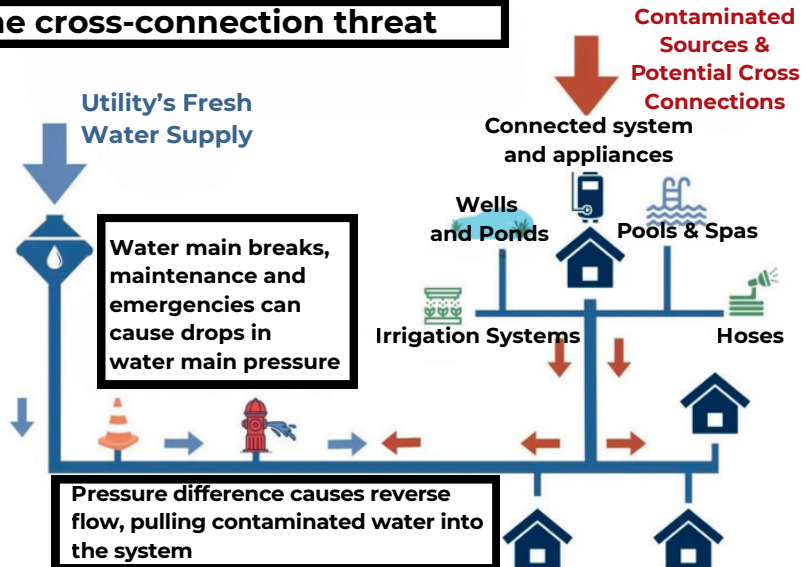

A backflow can occur when a substance flows back into the public water system as water pressure fluctuates due to a water line break or hydrant usage.

Backflow prevention devices prohibit dangerous contaminants from being drawn into the water system by restricting the flow of water to only one direction.

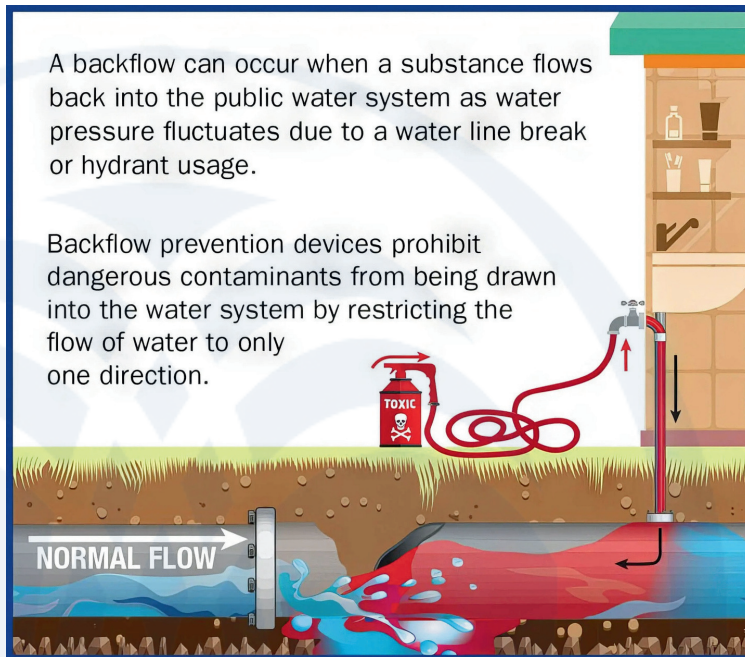

If you have ANY QUESTIONS regarding backflow risks or preventions devices, please contact **Hastings Utilities Water Department Phone: (402) 463-1371**



Hastings Utilities 1228 North Denver Ave.
Hastings, NE 68902

www.hastingsutilities.com



At Your Service

Providing Electric, Gas, Water and Sanitary Sewer Services



Hastings Utilities Advisory Board Members

Chairman- Bill Hitesman Vice Chairwoman- Jeanette Dewalt
Secretary- Scott Kvols Susan Meeske, Regg Rutt

Marzo 2026

Riesgos de reflujo y métodos de prevención

Sus responsabilidades:

En última instancia, los propietarios y ocupantes de cualquier propiedad son responsables de conocer y gestionar los riesgos de reflujo. También es responsable de responder con la mayor precisión A SU CONOCIMIENTO sobre la encuesta cuando la reciba con su factura de agua.

Una vez que hayamos recibido su encuesta, conservaremos esta información en nuestros registros durante CINCO AÑOS.


Si no ha recibido una encuesta, no es necesario que responda.

Completa la encuesta (elige solo UNA)

Opción A:
escanea el código al final de esta página

Opción B:
Vaya en línea a www.cityofhastings.org, busque "backflow survey" y complete la información.

La amenaza de la conexión cruzada

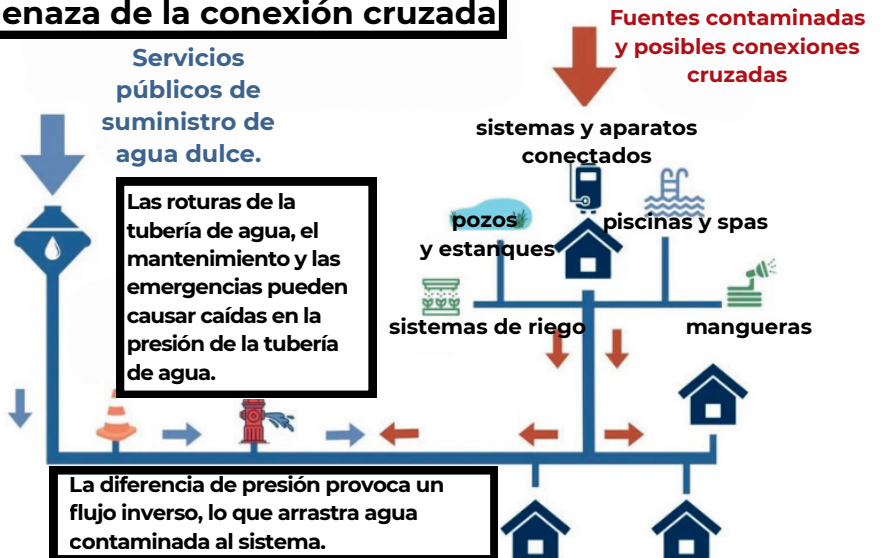

Dispositivos antirreflujo comunes
Estos son algunos ejemplos de cómo PODRÍA verse tu dispositivo. Algunas marcas y modelos varían.

Para pozos y calderas:
Estos se encuentran en su plomería INTERIOR.



Para grifos exteriores:
Busque accesorios como los que están marcados aquí



Para rociadores: Estos están afuera.




Para fregaderos utilitarios: Si conecta mangueras



Puede ocurrir un reflujo cuando una sustancia regresa al sistema público de agua debido a que la presión del agua fluctúa debido a una rotura de una línea de agua o al uso de un hidrante.

Los dispositivos de prevención de reflujo prohíben que contaminantes peligrosos ingresen al sistema de agua al restringir el flujo de agua a una sola dirección.

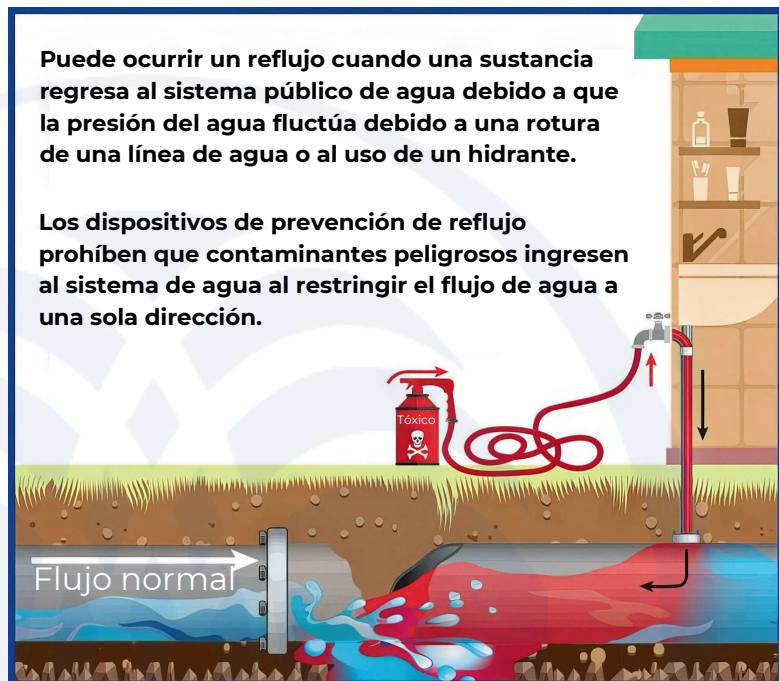

Si tiene ALGUNA PREGUNTA sobre los riesgos de reflujo o los dispositivos de prevención, comuníquese con el **Departamento de Agua de Hastings Utilities Teléfono: (402) 463-1371**



Hastings Utilities 1228 North Denver Ave.
Hastings, NE 68902

www.hastingsutilities.com

